


Energy Analyzer

MMW03-M22CH

User Manual



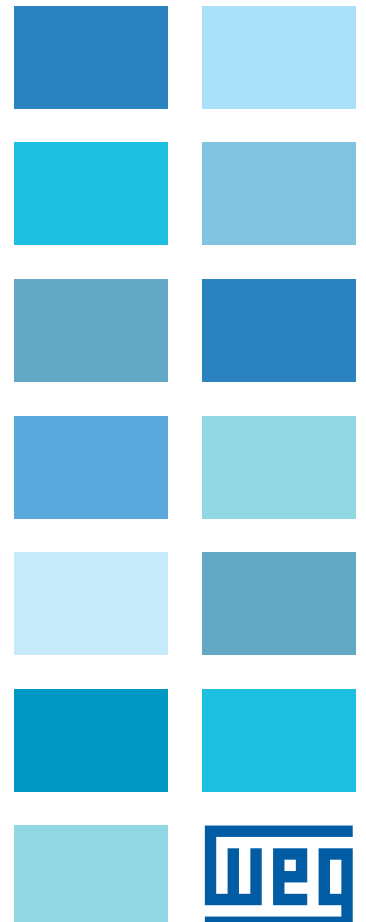

User Manual

Series: MMW03-M22CH

Language: English

Document: 10006614878 / 00

Summary

1 GENERAL INFORMATION	6
1.1 DEVICE FEATURES	6
1.2 CORRECT USAGE AND CONDITIONS FOR SAFETY	7
1.3 PANEL DEFINITIONS.....	7
1.4 MENU STRUCTURE	8
1.4.1 Key Functions.....	8
1.5 FOUR QUADRANT REPRESENTATION	11
2 INSTALLATION	12
2.1 PREPARING FOR INSTALLATION	12
2.2 MOUNTING	12
2.3 CONNECTION DIAGRAMS	12
2.3.1 3P-4W and 3p-3W Connections.....	12
2.3.2 Digital Output Connection Diagram	13
2.4 DIMENSIONS MMW03-M22CH (MM).....	13
3 MENUS	14
3.1 INSTANTANEOUS MEASUREMENT MENUS	14
3.2 MAXIMUM, MINIMUM VE DEMAND MENUS.....	14
3.3 ENERGY METERS MENU (ENERGY)	15
3.3.1 Assigning Predefined Value for Energy Meters	17
3.4 COUNTERS MENU (COUNTERS).....	17
3.5 SETTINGS MENU (SETTINGS).....	18
3.5.1 Basic Settings Menu (BASIC)	23
3.5.2 Alarm Settings Menu (ALARMS).....	23
3.5.3 Alarm Relay Settings Menu (RELAYS) (MMW03-M22CH)	24
3.5.4 Demand Period Setting Menu (DEMAND).....	24
3.5.5 RS485 Settings Menu (RS485).....	24
3.5.6 3.5.6 Digital Input Settings Menu (DI INPUT)	24
3.5.7 Pulse Output Settings Menu (PULSE).....	25
3.5.8 Password Settings Menu (SECURITY)	25
3.5.9 Display Setup (DISPLAY)	26
3.5.10 Clear Menu (CLEAR)	26
3.6 SAVE, CHANGING VALUE AND APPROVAL PROCEDURE.....	27
3.6.1 Changing Value/Setting	27
3.6.2 Save Procedure	27
3.6.3 Approval Procedure	28
4 RS485 COMMUNICATION	29
4.1 READABLE AND WRITABLE DATA	29
4.1.1 Status/Alarm Flags.....	36
4.2 MULTIPLE CHOICE SETTINGS VIA MODBUS.....	37
5 FACTORY DEFAULT SETTINGS	38
6 TECHNICAL SPECIFICATIONS	40

1 GENERAL INFORMATION

1.1 DEVICE FEATURES

MMW03-M22CH is designed to measure:

- Phase-neutral voltages;
- Phase-phase voltages;
- Phase current;
- Neutral current;
- Frequency;
- $\text{Cos}\phi$;
- Power factors;
- Active powers;
- Reactive powers;
- Apperant powers;
- THDV;
- THDI;
- 1-31 current and voltage harmonics.

Besides, MMW03-M22CH has numerous features such as:

- Phase loss information and sequence error display;
- Determining and saving in the memory of maximum and minimum values of current, voltage, frequency, $\text{cos}\phi$, power factor, THDV, THDI, active, reactive and apparent;
- Measuring current, active power, reactive power and apparent power values and saving in the memory;
- Setting alarm for current, voltage, frequency and power factor parameters;
- 2 tariff meters. These meters record Import Active, Export Active, Import Reactive, Export Reactive;
- Storing on hour counter (on hour), run hour counter (total energized time) and power interruption counter;
- RS485 communication via MODBUS RTU protocol;
- Digital inputs in order to start counter, 2nd tariff or run hour counter;
- Digital outputs which can be set to energy meters or counters as output parameters;
- 2 alarm relay outputs;
- Avoiding unauthorized control by a 4-digit-password.

	MMW03-M22CH
Type of device enclosure	Panel
Basic measurements (V, VLL, I, IN, F, $\text{Cos}\phi$, PF, P, Q, S, THD)	●
1-31 Harmonics	●
Max-Min Value	●
Demand Values (I, P, Q, S)	●
On hour, Run Hour, Int	●
Energy Meters	2 tariffs
Assigning alarm to the parameters	●
Alarm Relay	2 Qty
RS485	●
Digital Input	2 Qty
Digital Output	2 Qty
Indicators and leds	●
Order no	14387019

Tabela 1.1: Product Features

1.2 CORRECT USAGE AND CONDITIONS FOR SAFETY

- Installation and wiring must be performed by authorized technicians in accordance with the instructions in the user manual. Do not commission the device before proper wiring.
- Make sure the device is de-energized before connecting to the mains.
- Short circuit the k-l terminals of the current transformer in another location before disconnecting the current transformers. Failing to do so will cause dangerous high voltages in the secondary terminals of the current transformers.
- Use a dry cloth to clean the device. Do not use alcohol, thinner or any abrasive materials.
- Make sure all wiring is properly made before commissioning the device.
- Do not open the device. There are no serviceable parts by the user.
- Keep the device away from humidity, water, vibrations and dust.
- It is advisable to connect a circuit breaker or an automatic fuse between the current input of the device and the mains (2 amps).



CAUTION!

The manufacturer does not assume any responsibility for any undesired consequences if the above measures are not adhered to.

1.3 PANEL DEFINITIONS

Front Panel

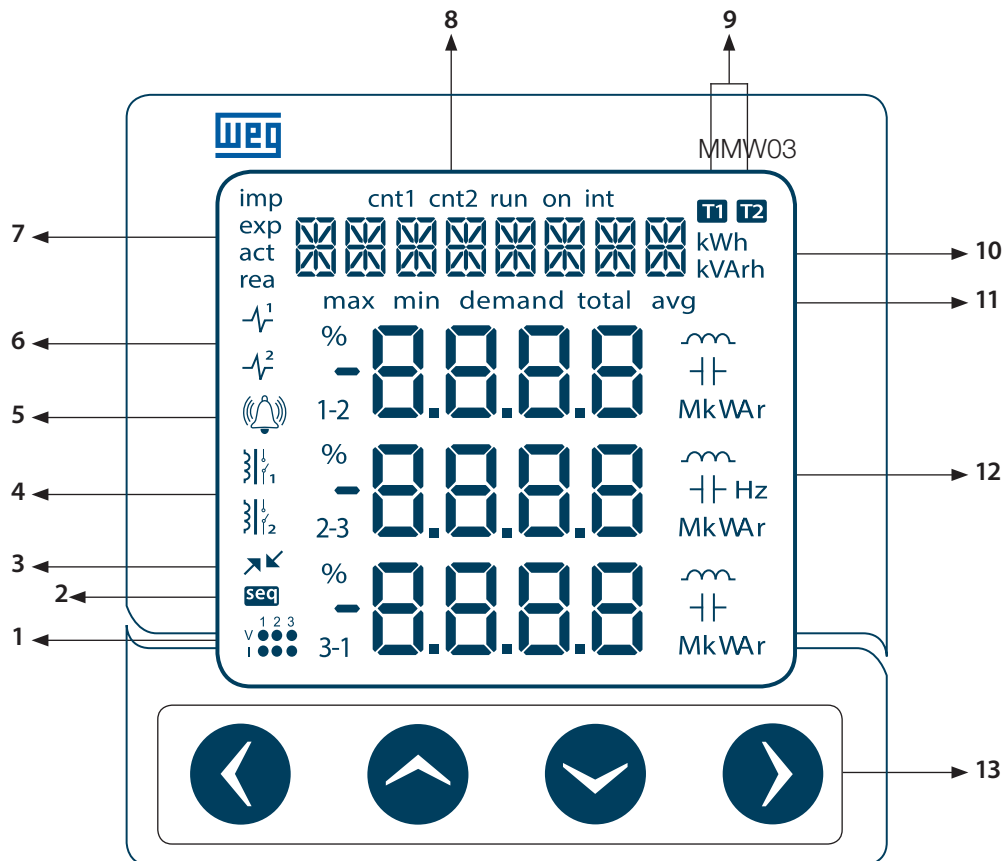


Figura 1.1: MMW03-M22CH Front Panel

- | | | | |
|---|---|-------------------------------|------------------------------------------------|
| 1 | → | Current and Voltage situation | :Indicate phase loss of currents and voltages. |
| 2 | → | Sequence error icon | :Indicate sequence error of voltages. |
| 3 | → | Communication active icon | :Indicate that RS485 communication is made. |
| 4 | → | Relay icons | :Indicate that relays are activated. |
| 5 | → | Alarm icon | :Indicate that there is alarm on the system. |
| 6 | → | Pulse output icons | :Indicate that pulse outputs are activated. |

- 7 → Energy counter icons :Indicate the type of the counter on the menu bar.
- 8 → Counter icon :Indicate the type of the counter on the menu bar.
- 9 → Tariff icons :Indicate that the counter of which tariff on the menu bar.
- 10 → Menu bar and counter units :Indicate menu names, energy counter and counters and settings.
- 11 → Submenu icons :Show that values of which submenu on the indicators.
- 12 → Indicators and units :Indicate measurements, maximum, minimum and demand values and their units.
- 13 → Keys :Use this key to switch between the menus and change the numerical values.

Back Panel

- I1-k1, I2-k2, I3-k3 :Current measurement inputs.
- V1, V2, V3, N :Voltage measurement inputs.
- D+, GND1, D :RS 485.
- DI1, GND, DI2, GND :Digital Inputs.
- DO1+, DO1-, DO2+, DO2- :Digital Outputs.
- out1, out2 :Alarm relay outputs.
- Un :Power supply.

1.4 MENU STRUCTURE

The menus are shown instantaneous measurements menu and their maximum, minimum, demand, average and total value at the tables below. The menu pages change with up, down, right and left direction buttons.

1.4.1 Key Functions

The buttons placed front panel and their functions are explained at the table below.

	At the Measurements Menu		At The Energy, Counters, Harmonics, Settings Menu		Initialize the Counter		To change the settings	
	Short Pressing (t < 2sec)	Long Pressing (t > 2sec)	Short Pressing (t < 2sec)	Long Pressing (t > 2sec)	Long Pressing (t < 2sec)	Long Pressing (t > 2sec)	Short Pressing (t > 2sec)	Long Pressing (t > 2sec)
Right button	switching between menus	Skips to "ENERGY" menu	Pass to the one sub-menu	Skips to bottom menu	Changes the active step	Activates the value changing	Activates the value changing or Changes the active step	N/A
Down button	switching between menus	N/A	Changes the menu page	N/A	Changes the values	N/A	Changes the value	N/A
Up button	switching between menus	N/A	Changes the menu page	N/A	Changes the value	N/A	Changes the value	N/A
Left button	switching between menus	Skips to Starting Page	Pass to the one upper-menu	Skip to the last menu from	Stops changing value and confirms the entering value	N/A	Stops changing value and confirms the entering value	N/A

Tabela 1.2: Key Functions

	Instantaneous Value	Max.	Min.	Demand	Avg/Total	Avg max/ Total max	Avg min/ Total min	Total Demand
	↕	↕	↕		↕	↕	↕	
<Voltage(L-N)>	↔ VL-N ↔	↔ Max. VL-N ↔	↔ Min. VL-N ↔		↔ Avg. VL-N ↔	↔ Max. Avg. VL-N ↔	↔ Min. Avg. VL-N ↔	
	↕	↕	↕		↕	↕	↕	
<Voltage(L-L)>	↔ VL-L ↔	↔ Max. VL-L ↔	↔ Min. VL-L ↔		↔ Avg. VL-L ↔	↔ Max. Avg. VL-L ↔	↔ Min. Avg. VL-L ↔	
	↕	↕	↕	↕	↕	↕	↕	↕
<Current>	↔ I ↔	↔ Max. I ↔	↔ Min. I ↔	↔ Demand I ↔	↔ Total I ↔	↔ Max Total I ↔	↔ Min. Total I ↔	↔ Total Demand I ↔
	↕	↕	↕	↕	↕	↕	↕	↕
<I Neutr> Neutral Current (In)	↔ IN ↔	↔ Max. IN ↔	↔ Min. IN ↔					
	↕	↕	↕					
<Cosq> Cos Ø	↔ COS Ø ↔	↔ Max. COS Ø ↔	↔ Min. COS Ø ↔					
	↕	↕	↕		↕	↕	↕	
<PF> Power Factor (PF)	↔ PF ↔	↔ Max. PF ↔	↔ Min. PF ↔		↔ Total PF ↔	↔ Max. Total PF ↔	↔ Min. Total PF ↔	
	↕	↕	↕	↕	↕	↕	↕	↕
<Power P> Active Power (P)	↔ P ↔	↔ Max. P ↔	↔ Min. P ↔	↔ Demand P ↔	↔ Total P ↔	↔ Max Total P ↔	↔ Min. Total P ↔	↔ Total Demand P ↔
	↕	↕	↕	↕	↕	↕	↕	↕
<Power Q> Reactive Power(Q)	↔ Q ↔	↔ Maks. Q ↔	↔ Min. Q ↔	↔ Demand Q ↔	↔ Total Q ↔	↔ Max. Total Q ↔	↔ Min. Total Q ↔	↔ Total Demand Q ↔
	↕	↕	↕	↕	↕	↕	↕	↕
<Power S> Apperant Power (S)	↔ S ↔	↔ Max. S ↔	↔ Min. S ↔	↔ Demand S ↔	↔ Total S ↔	↔ Max. Total S ↔	↔ Min. Total S ↔	↔ Total Demand S ↔
	↕	↕	↕	↕	↕	↕	↕	↕
<Σ P-Q-S> Total Power (Σ P-Q-S)	↔ Σ P-Q-S ↔	↔ Max. Σ P-Q-S ↔	↔ Min. Σ P-Q-S ↔	↔ Demand Σ P-Q-S ↔				
	↕	↕	↕	↕				
<Freq> Frequency(F)	↔ F ↔	↔ Max. F ↔	↔ Min. F ↔					
	↕	↕	↕					
<THD V>	↔ THDV ↔	↔ Max. THDV ↔	↔ Min. THDV ↔					
	↕	↕	↕					
<THD I>	↔ Anlik ↔	↔ Max. THDI ↔	↔ Min. THDI ↔					
	↕	↕	↕					

Tabela 1.3: Menu Switch-1 (Instantaneous Measurement Menus and Sub Menu)

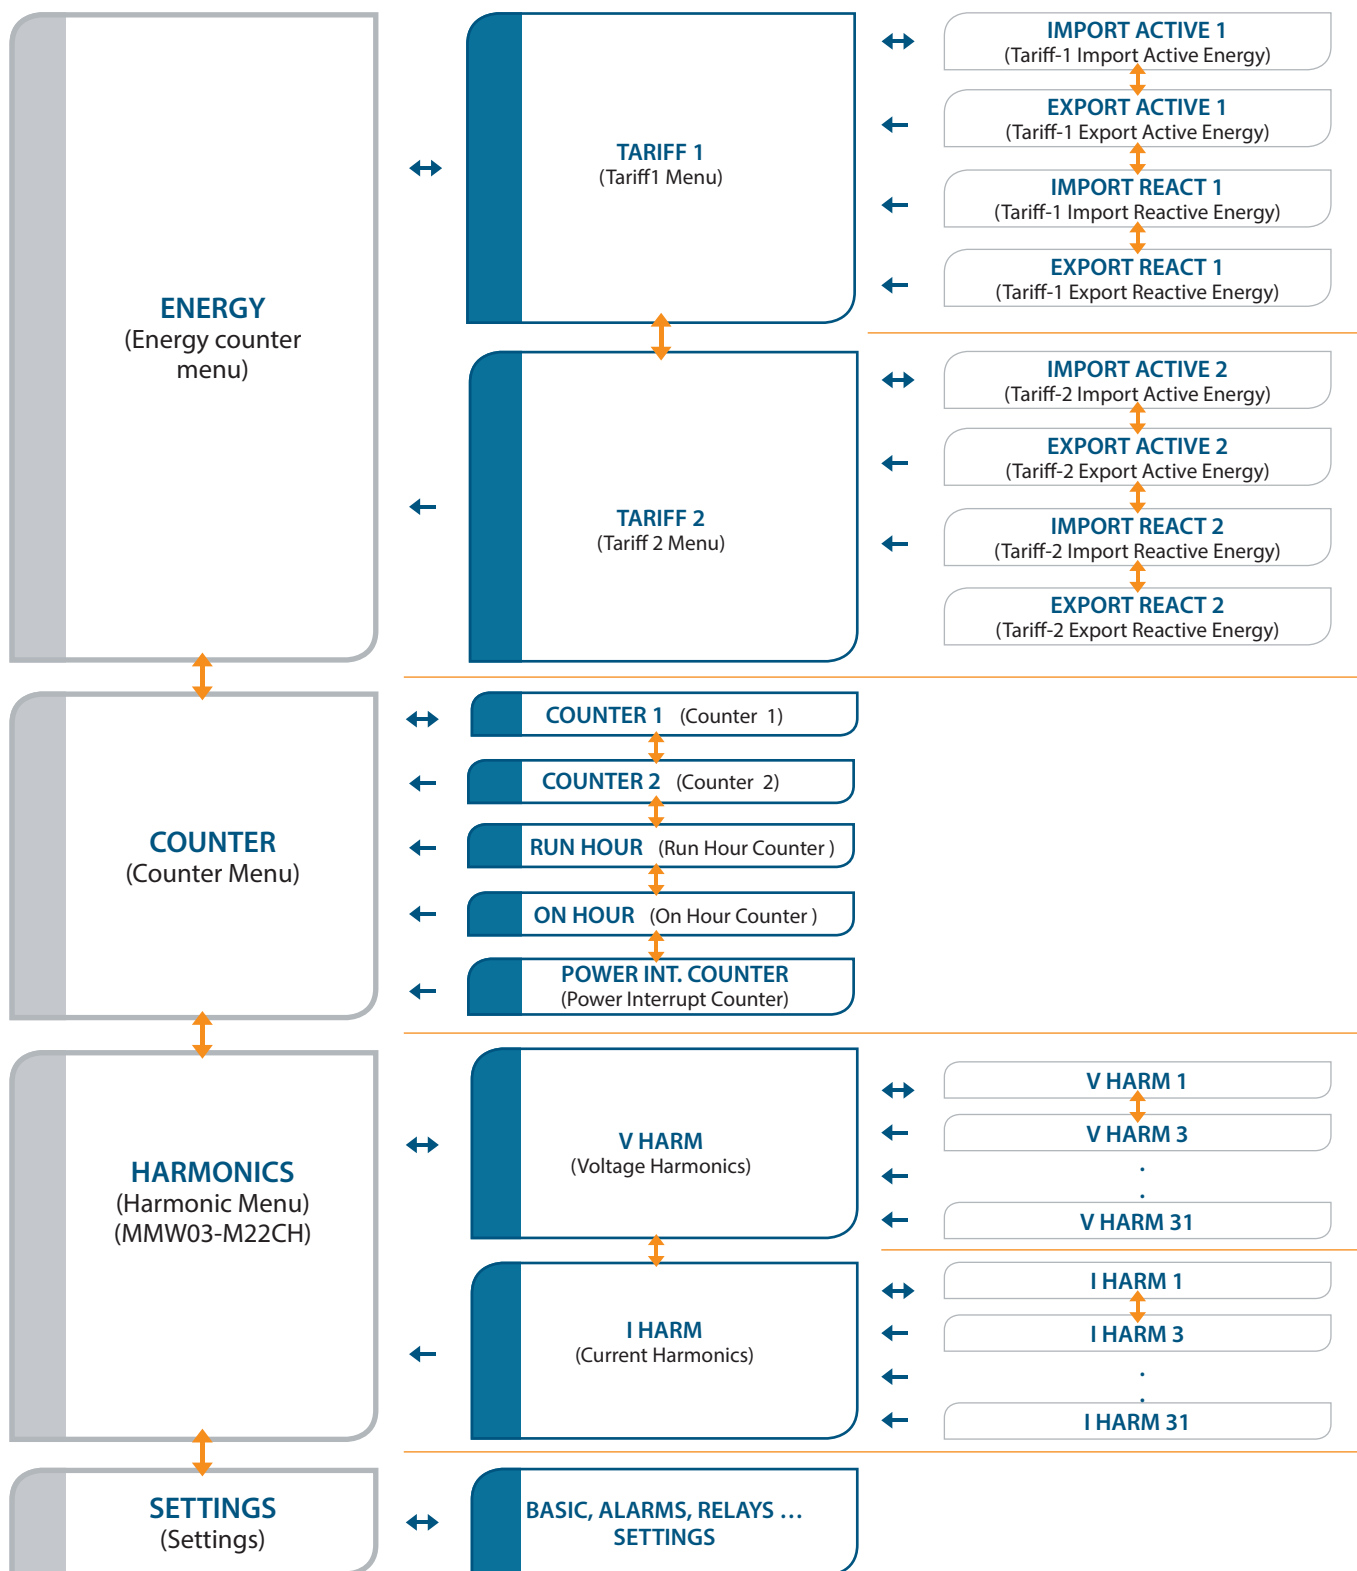


Tabela 1.4: Menu Switch-2 (Energy, Counters, Harmonics and Setting Sub-menus)

Energy counters, counters, odd harmonics up to 31st and settings menus are placed at the table above. Menu switching are made via up, down, right and left direction buttons as stated at the table.

NOTE:

Right button shall be pressed long in order to switch from Table 1-3 to Table 1-4, and.

1.5 FOUR QUADRANT REPRESENTATION

The angle(ϕ) between voltage and current provides us information about the direction of energy flow. A positive sign for active/reactive power indicates that active/reactive power is consumed. And also a negative sign for active/reactive power indicates that active/reactive power is generated.

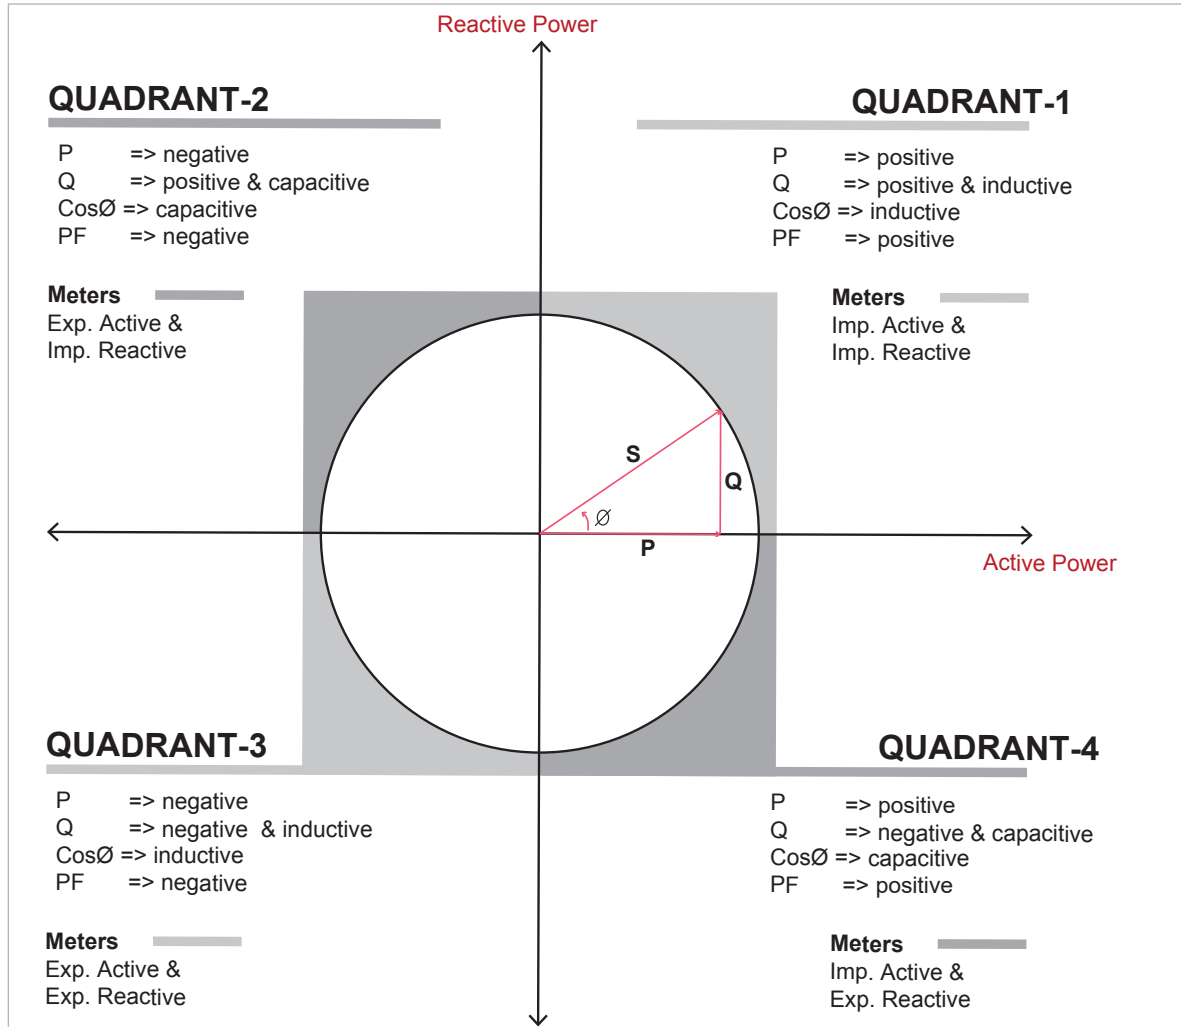


Figura 1.2: Four Quadrant Representation

NOTE:

If the signs of active and reactive power are examined, it can be defined the quadrant that MMW03-M22CH measures.

In order to understand P and Q signs in MMW03-M22CH 110P and Ecras, instantaneous displays for P and Q must be checked.

If active power display is seem constantly, it means active power(P) is positive. If it is blinked, it means active power(P) is negative.

If reactive power(Q) display is seem constantly, it means reactive power(Q) is positive. If it is blinked, it means reactive power(Q) is negative.

NOTE:

Signs of P and Q can be reached through modbus communication.

- E.g.;**
- P= +10kW, Q= +5kVAr => Quadrant-1
 - P= -10kW, Q= +5kVAr => Quadrant-2
 - P= -10kW, Q= -5kVAr => Quadrant-3
 - P= +10kW, Q= -5kVAr => Quadrant-4

2 INSTALLATION

2.1 PREPARING FOR INSTALLATION



DANGER!

Assembly and related connections of the product, must be implemented by authorized persons in accordance with the instructions of user manual.



DANGER!

The device must not be put into service if the operator is not sure that all connections are correctly accomplished.

2.2 MOUNTING

MMW03-M22CH is placed vertically into the gap located in the panel. After the product is placed into the panel, fixing brackets should be installed on the product. After that it should be fixed to the panel wall with the screws.



DANGER!

Before wiring up voltage and current ends to MMW03-M22CH, you must be sure that the power is cut.



DANGER!

The product is connected to current transformer(s). Before disconnecting current transformer leads, be sure that they are short circuited elsewhere or connected to a parallel load which has sufficiently low impedance. Otherwise dangerously high voltages will be induced at the current transformer leads. Same phenomena also apply for putting into service.

2.3 CONNECTION DIAGRAMS

2.3.1 3P-4W and 3p-3W Connections

There are two ways for connections of voltage and current. With neutral (3P-4W), without neutral (3P-3W).

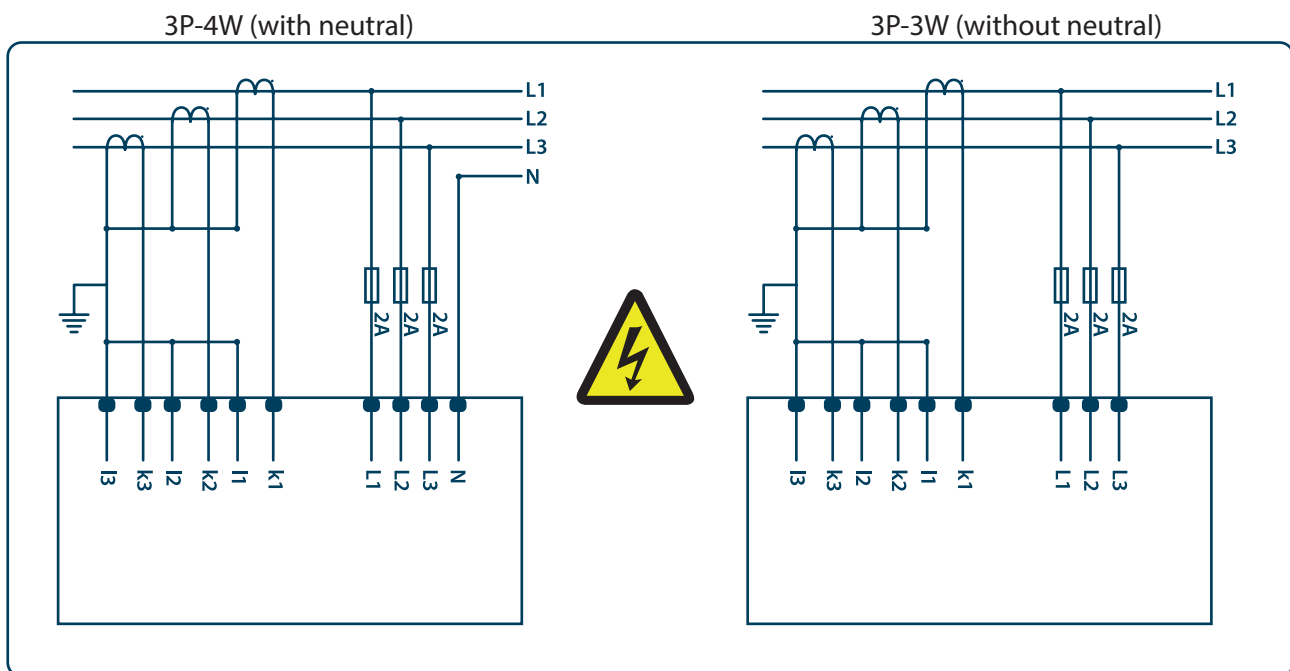


Figura 2.1: Connection Diagram



CAUTION!

Figure 1-1 1st item, displays current and voltage phase position are On/Off. If a current or voltage phase seems incomplete and should be checked by the relevant links / connections reached the device.

Figure 1-1 2nd item, if there is an error in the voltage phase during due to incorrect sequence; "Voltage phase sequence error icon" will appear. If this icon appears; phase-sequence voltage should be checked.

2.3.2 Digital Output Connection Diagram

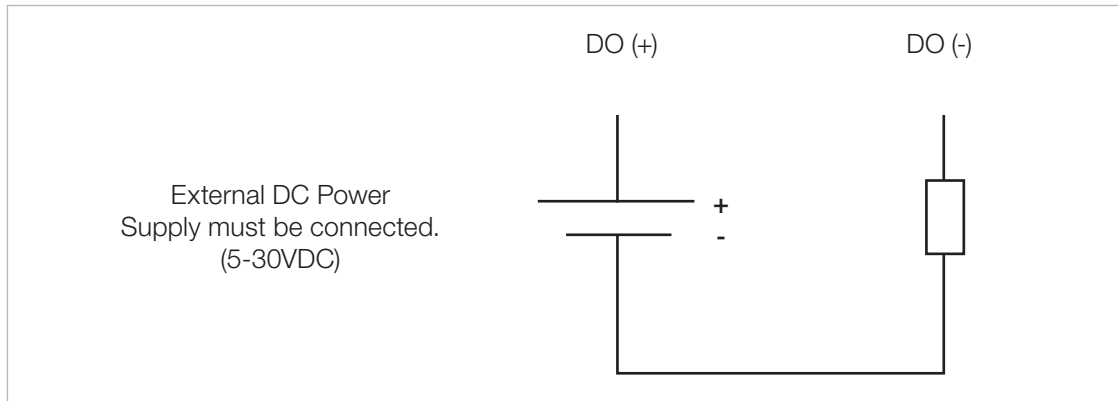


Figura 2.2: Digital Output Connection Diagram

2.4 DIMENSIONS MMW03-M22CH (MM)

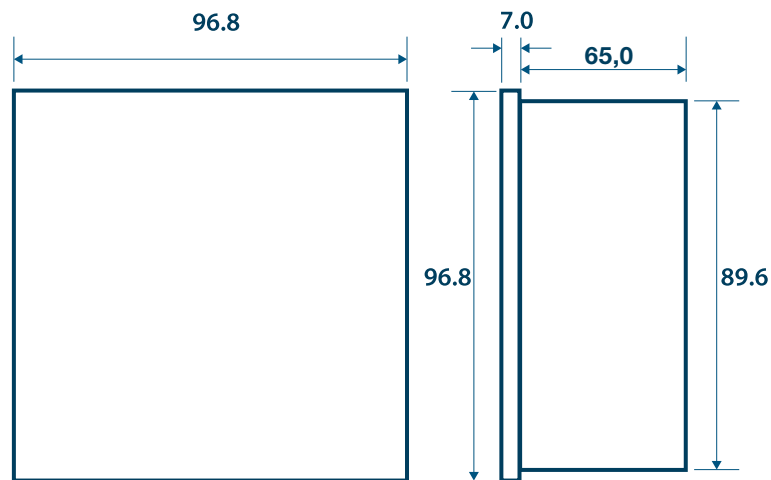


Figura 2.3: Dimensions for MMW03-M22CH

3 MENUS

3.1 INSTANTANEOUS MEASUREMENT MENU

Voltage (L-N and L-L), current, neutral current, $\cos\phi$, power factor, active power, reactive power, apparent power, THDV and THDI values are shown in instantaneous menu.

Menu are given the name of which is shown in Menu bar.

The values shown on the display is expressed in what phase or phases at the lower left corner of the display numbers.

Phase Numbers are not displayed at Menus which display average, total and other properties of network. In this case phases are displayed in 2. Level.

Next to each index value unit of respective rows are indicated. It also states that inductive or capacitive phases are indicated next to the relevant indicators.

Table 1-3 for parameters displayed in the menus.

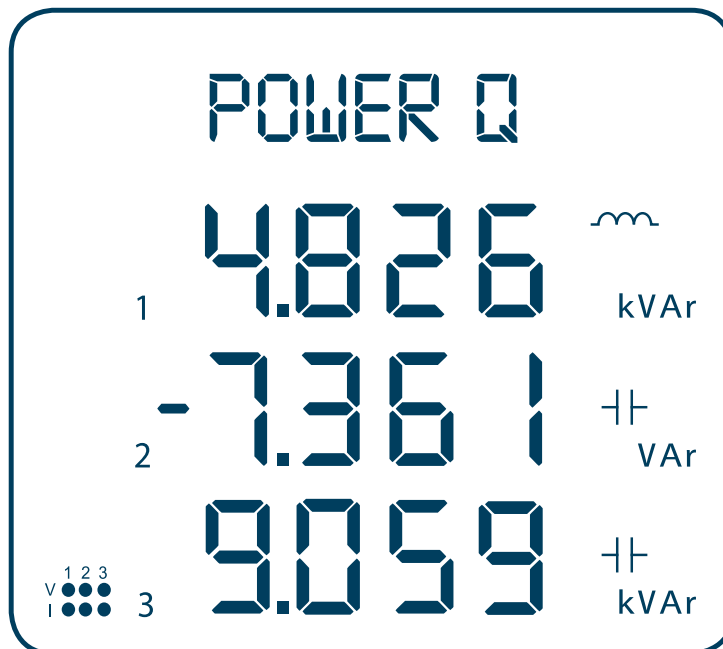


Figura 3.1: Instantaneous Measurement Menu (Reactive Power)



CAUTION!

When the product is mounted on a panel which consumes power, active power (P) must be positive. If active power is negative, operator should cross connect k-l leads of the current transformer.

When the product is mounted on a panel which generates power, active power (P) must be negative. If active power is positive, operator should cross connect k-l leads of the current transformer.

3.2 MAXIMUM, MINIMUM VE DEMAND MENUS

Minimum and maximum values are calculated and stored in the non-volatile memory for below parameters:

- Voltage (phase-neutral, phase-phase);
- Neutral current;
- Frequency;
- $\cos\phi$;
- Power factor;
- THDV;
- THDI.

Besides maximum and minimum values, demand values are calculated and stored in the non-volatile memory for below parameters:

- Current;
- Active power;
- Reactive power;
- Apparent power.

Table 1-3 shows the menu movements.

NOTE:

The values held in memory can be deleted by selecting "CLEAR" menu in the "SETTINGS" menu. Reset and return to the factory settings can be made with RS 485 communication.

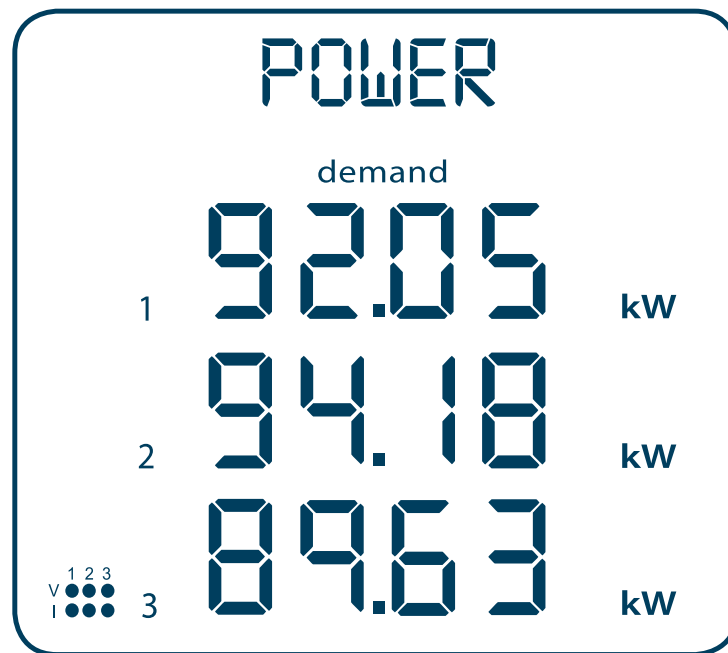


Figura 3.2: Instantaneous Measurement Menus (Active Power)

3.3 ENERGY METERS MENU (ENERGY)

These tariffs are shown in "Enr" menu. Each tariff has import active, export active, import reactive and export reactive meters.

- Import Active Energy Meter (I.Ac).
- Export Active Energy Meter (E.Ac).
- Import Reactive Energy Meter (I.rE).
- Export Reactive Energy Meter (E.rE).

The menu structure is shown below:

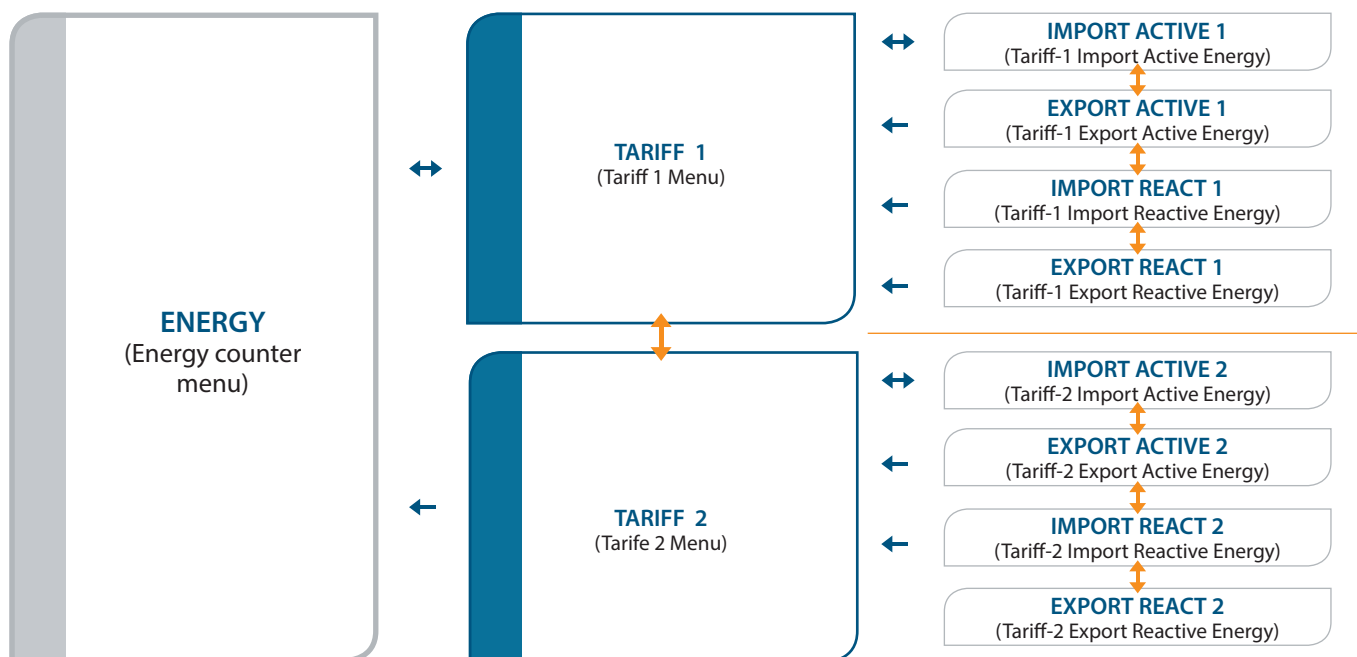


Tabela 3.1: Energy Meters Menu

The following menu icons are active in “ENERGY” menu:

- T1** : This icon appears with Tariff 1 counters.
- T2** : This icon appears with Tariff 2 counters.
- imp : This icon appears with import energy counters.
- exp : This icon appears with export energy counters.
- act : This icon appears with active energy counters.
- rea : This icon appears with reactive energy counters.

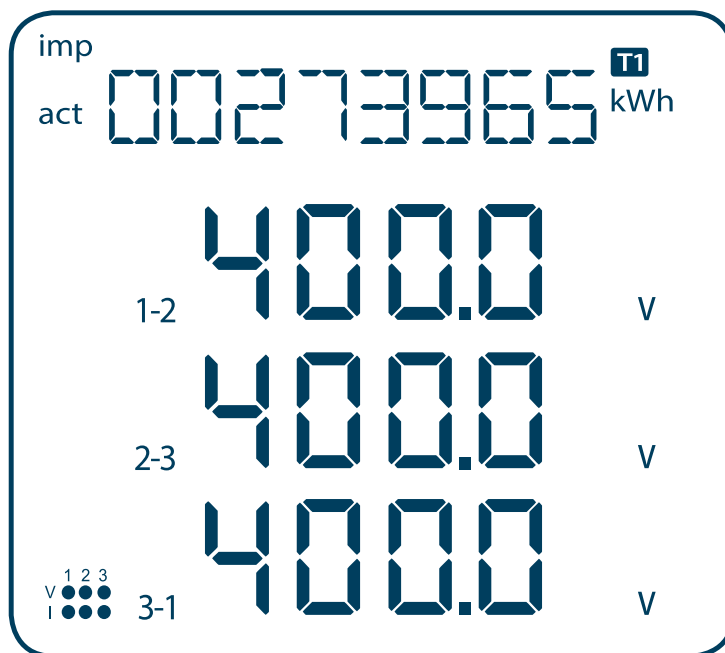


Figura 3.3: Tariff 1 Import Active Energy Menu



CAUTION!

Counters are displayed in the format xx xxx xxx kWh / kVArh (See: Figure 3-3). All counters are reset at 99 999 999 kWh / kVArh and then start over from zero. It is possible to initialize the counters under the “ENERGY” menu.



CAUTION!

To activate 2.tarif counters, firstly digital counter input type should be selected as 2.tarif ("tr2") and it must take an active position of the digital input. DI digital input becomes active when GND- ends are shorted. Otherwise 1.tarif is active.

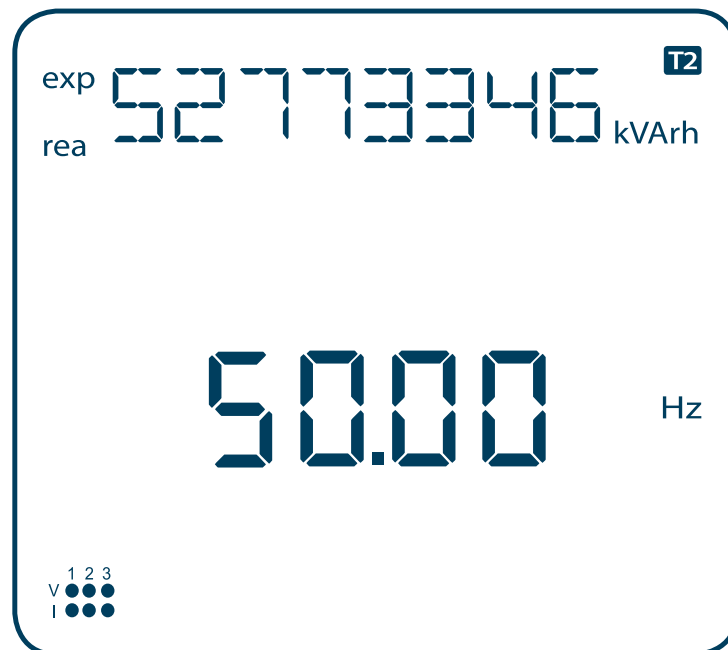


Figura 3.4: Tariff 2 Export Reactive Energy Menu

3.3.1 Assigning Predefined Value for Energy Meters

In any meter menu, press and hold the right key for at least 2 seconds and the respective menu title starts blinking. Using the right arrow key, move to the digit you want to change and enter the value using the up/down arrows. When you are done entering the value, confirm using the left arrow key. Move on to the storage procedure to store the changes you made. (See: 3.6.2 Save Procedure).



CAUTION!

If password protection is enabled, press and hold the right key for at least 2 sec to display the password authentication page. Enter the password to proceed to the counter assignment.

3.4 COUNTERS MENU (COUNTERS)

There are counters under the "COUNTERS" menu below:

- "COUNTER1": When a digital input 1 is assigned to a counter, it counts the changes in the digital input. The value is displayed in "COUNTER1" menu.
- "COUNTER2": When a digital input 2 is assigned to a counter, it counts the changes in the digital input. The value is displayed in "COUNTER2" menu.
- "ON HOUR" Counts and displays the total "on" time for the device in hours.
- "RUN HOUR": If the digital input type was set to "run hour enable", it counts the time elapsed during the digital input is in active position. This counter requires signal from 3- phase voltage and 3-phase current inputs to function without connecting to a digital input. The measured value is displayed in hours.
- "POWER INTERRUPTION COUNTER": Counts the power interruptions for the device.

"POWER INTERRUPTION COUNTER": Counts the power interruptions for the device.

The menu structure is shown below:

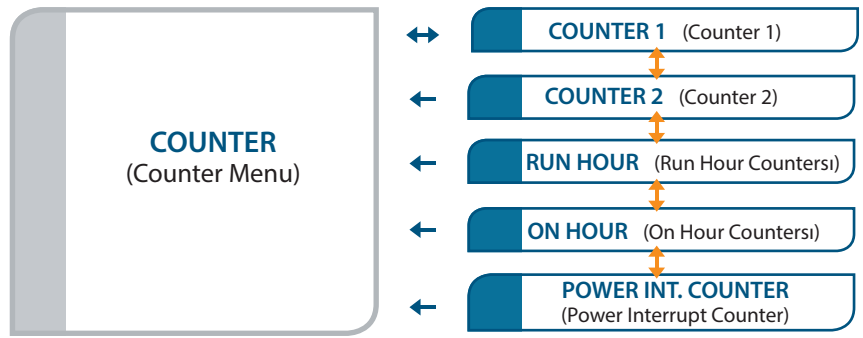


Tabela 3.2: Counters Menu Structure

Counters showing the following icons on the “COUNTERS” menu is active:

- cnt1 :This icon appears with “COUNTER1” counter;
- cnt2 :This icon appears with “COUNTER2” counter;
- run :This icon appears with “RUN HOUR” counter;
- on :This icon appears with “ON HOUR” counter;
- int :This icon appears with “POWER INTERRUPTION COUNTER” counter.

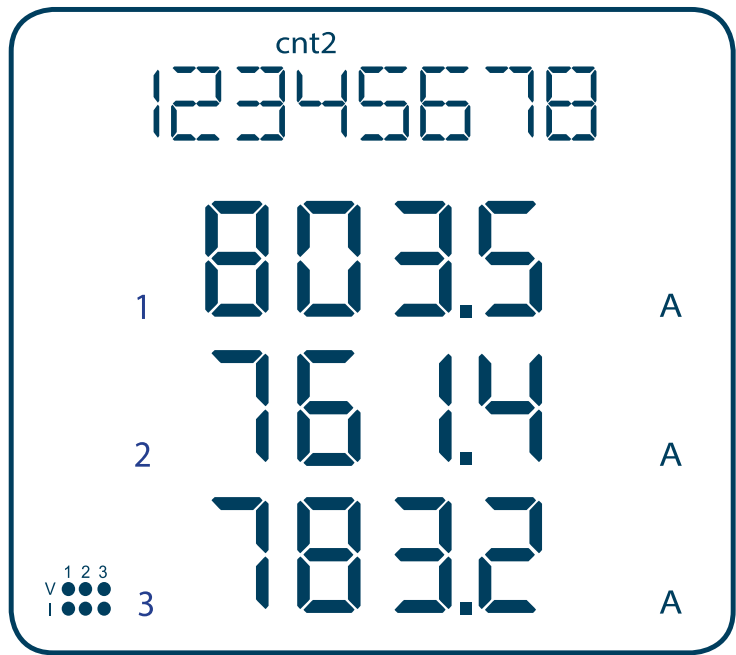


Figura 3.5: COUNTER2 Menu



CAUTION!

Counters are displayed as 8 digits. All counters are reset at 99 999 999 and then start over from zero.

Only “COUNTER1”, “COUNTER2” and “RUN HOUR” counters can be assigned values or reset. Use the procedure for assigning default values to assign values to counters.

See: 3.3.1 Save Procedure.

When the energy meters are displayed instantaneously, last measured parameters (such as voltage, current, active power values etc.) are continued to display under the energy meter value as well.

3.5 SETTINGS MENU (SETTINGS)

MMW03-M22CH settings are made in the SETTINGS menu. Table 3-3 shows the SETTINGS menu tree.

Menu	Sub Menu 1	Sub Menu 2	Sub Menu 3	Sub Menu 4	Description	
SETTINGS					Settings	
	BASIC				Basic settings	
		Ctr				Current transformer rate
		Utr				Voltage transformer rate
		Conn				Connection type options
			3P4W			3P4W connection type
		3P3W			3P3W connection type	
	ALARMS					Alarm setup
		VLN ALM				Voltage (phase-neutral) alarm setup
			HI			Voltage (phase-neutral) alarm high limit
			LO			Voltage (phase-neutral) alarm low limit
			hYSt			Voltage (phase-neutral) alarm hysteresis value
			dIY.t			Voltage (phase-neutral) alarm delay time
		VLL ALM				Voltage (phase-phase) alarm setup
			HI			Voltage (phase-phase) alarm high limit
			LO			Voltage (phase-phase) alarm high low limit
			hYSt			Voltage (phase-phase) alarm hysteresis value
			dIY.t			Voltage (phase-phase) alarm delay time
		I ALM				Current alarm setup
			HI			Current alarm high limit
			LO			Current alarm low limit
			hYSt			Current alarm hysteresis value
			dIY.t			Current alarm delay time
		IN ALM				Neutral current alarm setup
			HI			Neutral current alarm high limit
			LO			Neutral current alarm low limit
			hYSt			Neutral current hysteresis value
			dIY.t			Neutral current alarm delay time
		COSQ ALM				Cos ϕ alarm setup
			HI			Cos ϕ alarm high limit
			LO			Cos ϕ alarm low limit
			hYSt			Cos ϕ alarm hysteresis value
			dIY.t			Cos ϕ alarm delay time
		PF ALM				Power factor alarm setup
			HI			Power factor alarm high limit
	LO				Power factor alarm low limit	
	hYSt				Power factor alarm hysteresis value	
	dIY.t				Power factor alarm delay time	

Menu	Sub Menu 1	Sub Menu 2	Sub Menu 3	Sub Menu 4	Description		
SETTINGS	ALARMS	FREQ ALM			Frequency alarm setup		
			HI		Frequency alarm high limit		
			LO		Frequency alarm low limit		
			hYSt		Frequency alarm hysteresis value		
			dLY.t		Frequency alarm delay time		
	RELAYS	rLY1				Relay output setup	
						Relay 1 setup	
			OFF			Relay 1 OFF	
			LOW			Assign relay 1 to level low alarms	
		HIGH			Assign relay 1 to level high alarms		
		rLY2					Relay 2 setup
			OFF				Relay 2 OFF
			LOW				Assign relay 2 to level low alarms
			HIGH				Assign relay 2 to level high alarms
		DEMAND					Demand setup
	dEd.t					Demand time setup	
	RS485					RS485 setup	
		bAud				Baud rate options	
		Id				Slave ID setup	
		PrYt					Parity check setup
			NONE				Parity check off
			EVEN				Even parity
	ODD				Odd parity		
	DI INPUT	INPUT1				Digital input setup	
						Digital input 1 setup	
			tYPE				Digital input 1 options
				OFF			Off
				TARIFF 2			Enable tariff 2
				COUNTER			Enable counter
				RUN HOUR			Enable Run Hour
			dLY				Digital input 1 detection delay time
			EdgE				
RISING							Detection in rising edge
FALLING							Detection in falling edge (Only valid for counter)
BOTH EDG						Detection in both edges (Only valid for counter)	

Menu	Sub Menu 1	Sub Menu 2	Sub Menu 3	Sub Menu 4	Description			
SETTINGS	DI INPUT	INPUT2	tYPE		Digital input 2 setup			
					Digital input 2 options			
				OFF	Off			
				TARIFF 2	Enable tariff 2			
				COUNTER	Enable counter			
				RUN HOUR	Enable Run Hour			
			dLY		Digital input 2 detection delay time			
			EdgE		Digital input 2 detection edge			
				RISING	Detection in rising edge			
				FALLING	Detection in falling edge (Only valid for counter)			
				BOTH EDG	Detection in both edges (Only valid for counter)			
			PULSE	OUT1	OUT		Pulse output setup	
		Pulse output 1 setup						
		Pulse output 1 parameter setup						
	OFF	Off						
	IMP ACT1	Assign to tariff 1 import active energy counter						
	EXP ACT1	Assign to tariff 1 export active energy counter						
	IMP REA1	Assign to tariff 1 import reactive energy counter						
	EXP REA1	Assign to tariff 1 export reactive energy counter						
	IMP ACT2	Assign to tariff 2 import active energy counter						
	EXP ACT2	Assign to tariff 2 export active energy counter						
	IMP REA2	Assign to tariff 2 import reactive energy counter						
	EXP REA2	Assign to tariff 2 export reactive energy counter						
	PULSE	OUT1				OUT	DIN1	Assign to digital input 1 counter
							DIN2	Assign to digital input 2 counter
			durA	Pulse duration of the pulse output 1				
			rAt	Step range for pulse output 1				
		OUT2	OUT		Pulse duration of the pulse output 2			
					Step range for pulse output 2			
				OFF	Off			
				IMP ACT1	Assign to tariff 1 import active energy counter			
				EXP ACT1	Assign to tariff 1 export active energy counter			
				IMP REA1	Assign to tariff 1 import reactive energy counter			
	OUT2	OUT	EXP REA1	Assign to tariff 1 export reactive energy counter				
			IMP ACT2	Assign to tariff 2 import active energy counter				
			EXP ACT2	Assign to tariff 2 export active energy counter				
IMP REA2			Assign to tariff 2 import reactive energy counter					
EXP REA2			Assign to tariff 2 export reactive energy counter					
DIN1			Assign to digital input 1 counter					
DIN2	Assign to digital input 2 counter							

Menu	Sub Menu 1	Sub Menu 2	Sub Menu 3	Sub Menu 4	Description			
SETTINGS	PULSE	OUT2	durA		Pulse duration of the pulse output 2			
			rAt		Step range for pulse output 2			
	SECURITY					Password protection setup		
		Act				Enable/disable password protection		
			NO			password protection disable		
			YES			password protection enable		
		Pin.t				Timeout for password protection. If you do press any keys after entering the password or do not change any settings via MODBUS, password protection is re-enabled after the time has elapsed.		
		Pin				Password value		
	DISPLAY					Screen setup		
						Menu setup		
		MENU		ScrL	OFF		Menu scroll disable	
					ON		Menu scroll enable	
				Scr.P			Menu display time	
				Strt				
		VOLTAGELN					Home page Voltage(L-N)	
		VOLTAGELL					Home page Voltage(L-L)	
		CURRENT					Home page Current	
		DISPLAY	MENU		Strt	I NEUTR	Home page Neutral Current	
	COSQ					Home page CosQ		
	PF					Home page Power Factor		
	POWER P					Home page Active Power		
	POWER Q					Home page Reactive Power		
	POWER S					Home page Apperant Power		
	P-Q-S					Home page Total Power		
	FREQ					Home page Frequency		
	THD V					Home page THDV		
	THD I					Home page THDI		
	BACKLGH						Display backlight setup	
							Display backlight options	
						oPt	TIME DEP	Display backlight depending on the time
						CONT ON		Display backlight always on
						CONT OFF		Display backlight always off
		durA		Display backlight always on time				

Menu	Sub Menu 1	Sub Menu 2	Sub Menu 3	Sub Menu 4	Description	
SETTINGS	CLEAR				Clear Menu	
		CLr				
			OFF			Clear abort
			ALL			Reset the device to factory settings
			ENERGY			Clear the energy counters
			COUNTERS			Clear the counters
			MAX VALS			Clear the max. values
			MIN VALS			Clear the min. values
			DEMANDS			Clear the demand values
			SETTINGS			Reset the setup to factory settings
			ALARMS KLEA 220P POWYS 3121			Reset the alarm setup to factory settings
		INFO				Information
		UEr			Firmware version information	

Tabela 3.3: SETTINGS Menu

3.5.1 Basic Settings Menu (BASIC)

This is the menu item where you make the current transformer ratio, voltage transformer ratio and connection type settings. Please see Table 3-3 for the menu tree and SECTION 5 for the menu tree and Section 5 for the factory default settings.

Current transformer ratio (Ctr): The calculated currents are multiplied by the current transformer ratio (Ctr) to be indicated on the displays and the modbus addresses.

Voltage transformer ratio (Utr): The calculated voltages are multiplied by the voltage transformer ratio (Utr) to be indicated on the displays and the modbus addresses.

Connection (Conn): This menu is for the network connection settings.

If “3P4W” (3-phase, 4-wire connection type) was specified for the network connection setup, the initial menu is “Voltage (Phase-Neutral)”. This menu is displayed first when the device is energized.

If “3P3W” (3-phase, 3-wire connection type) was specified for the network connection setup, the initial menu is “Voltage (Phase-Phase)”. This menu is displayed first when the device is energized.




3.5.2 Alarm Settings Menu (ALARMS)

Use this menu item to set the alarm limits, hysteresis value and alarm delay time. Please see Table 3-3 for the menu tree and SECTION 5 for the factory default settings.



CAUTION!

Outside the alarm limits:

- The values which are belong to adjusted alarm parameter, start flashing.
- When alarm delay time is expired, () symbol is displayed in main screen.
- If relay outputs are assigned to any alarm and also if there is an alarm in the system, related relay symbols ( , ) are displayed in the main screen after alarm delay time.

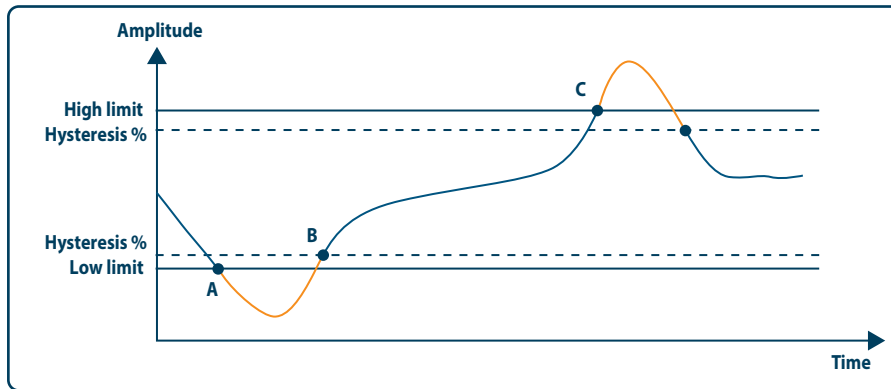


Figura 3.6: Alarm Example

- A low limit alarm occurs at point A.
- Alarm disappears at point B.
- A high limit alarm occurs at point C.
- Alarm disappears at point D.

3.5.3 Alarm Relay Settings Menu (RELAYS) (MMW03-M22CH)

Use this menu item to set the conditions of the alarm relays. You can set both alarm relays to the following positions:

- OFF : Relay does not energize in an alarm condition;
- LO : Relay energizes when a low limit alarm occurs;
- HI : Relay energizes when a high limit alarm occurs.

Related relay is de-energized when the alarm condition ends. Please see Table 3-3 for the menu tree and SECTION 5 for the factory default settings.

3.5.4 Demand Period Setting Menu (DEMAND)

Use this menu item to setup the demand period. At the end of the specified period, demand values are calculated in a periodic cycle.

Please see Table 3-3 for the menu tree and SECTION 5 for the factory default settings.

3.5.5 RS485 Settings Menu (RS485)

Use this menu item to set the baudrate, slave ID and parity control settings in RS485 communication. Please see Table 3-3 for the menu tree and SECTION 5 for the factory default settings.

Baudrate (bAud): Communication Signal speed is expressed with "baud" in terms of units. The baud rate can be changed in the adjustment range.

Slave ID (Id): RS485 communication is working on the basis of one or more slave devices communicate with one master. MMW03-M22CH, as a slave in the RS485 communication responds to queries made by the master. If the device is slave match in this communication are set in the slave ID Menu.

Parity Check (PrTY): It is a control mechanism for data accuracy. It counts odds "1" in Binary data. There are "odd" and "even" parity control method. For communication, master and slave devices must be using the same method. The desired method is selected from the menu or "NONE" option selected to make parity check feature turned off.

3.5.6 3.5.6 Digital Input Settings Menu (DI INPUT)

Use this menu item to set the on/off position, type, delay time and detection edge for the digital input. Please see Table 3-3 for the menu tree and SECTION 5 for the factory default settings.

**CAUTION!**

Digital input is based on dry contact detection principle. Never apply signal to inputs. Otherwise there is risk of damaging the device.

Digital input type (tYPE):

- Option to enable tariff 2 (TARIFF 2): If you choose this option for the digital input type, tariff2 energy counters will be enabled when the digital input is active (dry contact must be applied from related DIN+ and DIN-).
- Option to enable the counter (COUNTER): If you choose this option for the digital input type, the counter will count the changes in the position of the digital input depending on the chosen detection edge.
 - If you choose rising edge detection (RISING) for the detection edge, the counter will increase by 1 on each activation of the dry contact that is connected to the digital input.
 - If you choose falling edge detection (FALLING) for the detection edge, the counter will increase by 1 on each de-activation of the dry contact that is connected to the digital input.
 - If you choose both edges detection (BOTH EDGE) for the detection edge, the counter will increase by 1 on each activation and de-activation of the dry contact that is connected to the digital input.
- Run Hour enable option (RUN HOUR): If you choose this option for the digital input type, the “run hour counter” start counting when the digital input is active. (Dry contact must be applied from related DIN+ and DIN-).

Detection delay time (dLY):

The input is enabled or disabled based on the detection delay time which is set to account for contact spikes or noise in the digital input.

Detection edge (EdgE):

Use this menu item to choose the position where the digital input is detected active or passive. This menu is available only for the digital input mode “counter”. Other options always use the rising edge detection.

3.5.7 Pulse Output Settings Menu (PULSE)

Use this menu item to specify the on/off position, output parameter, pulse duration and step range settings for the pulse outputs. You can freely choose the settings for each pulse output independent of each other. Please see Table 3-3 for the menu tree and SECTION 5 for the factory default settings.

The pulse output is activated with an increase in the predefined output parameter that is equal to each step range and deactivates after the predefined time.

Output parameter setup (OUT):

Use this menu item to set the parameter dependency of the output. The respective output is closed when you choose “OFF”.

Pulse duration setup (durA):

Use this menu item to specify the time the pulse is active.

Pulse step range (rAt):

Use this menu to specify the smallest possible increase for the input parameter that will output a pulse.

3.5.8 Password Settings Menu (SECURITY)

Use this menu item to turn the password protection on/off, set a password activation time and change password settings editing options. Please see Table 3-3 for the menu tree and SECTION 5 for the factory default settings.

4 digit password protects the product setup and counter menus against unauthorized access and modifications. When activated, a password query screen is displayed if someone attempts to change the values. After a successful login, the device will not ask for a password until the “password activation time” has elapsed. You can set this value in the respective menu item. Please see Table 3-3 for the menu tree and SECTION 5 for the factory default settings.

**CAUTION!**

If you do not press any keys after entering the password or do not change the settings via MODBUS, password protection is re-enabled after the password activation time has elapsed.

3.5.9 Display Setup (DISPLAY)

The settings about menu screen and backlight are made in this menu.

Menu Setup (MENU):

Menu scroll setting, display time and start page are made in this sub-menu:

- Menu scroll setup (ScrL): Menu Navigation is given as a name to command which is moving menu screen to next one at the end of display time. If "ON" is selected, menu navigation is activated after device start or 15 seconds after the last key is pressed.
- Menu display period (Scr.P): Each menu appears in the screen during the period that is adjusted in "menu display time". The unit is second and it is effective when menu scroll mode is "on". It is ineffective when menu scroll mode is "off".
- Home page setup (Strt): When the device is first energized, first screen menu is called Menu opening page. Any of this menu can be set from available instantaneous measurements Menu as Home page. Pre value "VOLTAGELN" menu is designated as Home page.

Display Backlight Setup (BACKLGH)

Is subhead which lets adjustment of display backlight options and duration of backlight.

- I Display backlight options (oPt): This menu is adjustment of display backlight activation depending on the time (TIME DEP), always on (CONT ON) or permanently closed (CONT OFF).
Time Dependent (TIME DEP): Backlight is turned on with device operates or with a pressing any key. Display backlight will be turned off if there is no pressing any key after set time. It is preferred to have longer-lasting power-saving and LED lighting.
 - Continuous ON (CONT ON): Display backlight stays on permanently.
 - Continuous OFF (CONT OFF): Display backlight is permanently closed.
 - Display Backlight On Time (durA): Menu is where screen backlight time period is set with unit of second.
- Display Backlight On Time (durA): Menu is where screen backlight time period is set with unit of second.

3.5.10 Clear Menu (CLEAR)

Use this menu to delete the stored values in the memory and restore the factory settings. Please see Table 3-3 for the menu tree and SECTION 5 for the factory default settings.

The following options are available in the clear menu:

- OF : Disables the clear process.
- ALL : Clears all values stored in the memory and restores them to the default factory settings.
- ENERGY : Resets all energy counters.
- COUNTERS : Resets all counters.
- MAX VALS : Clears the maximum values stored in the memory.
- MIN VALS : Clears the minimum values stored in the memory.
- DEMAND : Clears the demand values stored in the memory.
- SETTINGS : Restores all settings to the factory settings.
- ALARMS : Restores the alarm settings to the factory settings.

In order to prevent an accidental deletion, "NO" / "YES" prompt is displayed if you choose any option other than "OFF" 3.6.3 Approval Procedure:

- To confirm the action:
Press the right key to blink the "NO" sign. Use the up/down keys to change the "NO" to "YES". Then, press the left key to confirm the action.
- To discard the action:
Press the right key to blink the "NO" sign. Then, press the left key to confirm the "NO" option and exit the menu without making any deletions.




CAUTION!

The device restarts if you choose SETTINGS, ALARM or All and confirm the action. It will not restart if you choose other options. It will clear the values and returns back to the CLEAR menu.

3.6 SAVE, CHANGING VALUE AND APPROVAL PROCEDURE

3.6.1 Changing Value/Setting

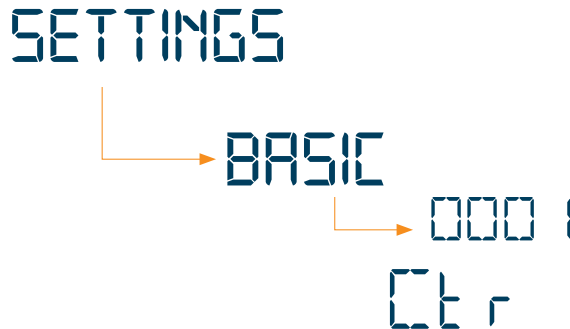

Menu titles in the menu "SETTINGS" are displayed in the menu bar. When the submenus are entered into, the menu in which the change will occur is shown in the indicator in the first row and the value belonging the related setting is shown in the menu bar and the change may be made here.

There are 2 different menus for changing the values:

- Multiple choice menus: These menus contain predefined options. Press the right key to choose and blink the first variable of the menu. Press the up/down keys to choose and blink the desired option. Then press the left button to complete your choice.
- Menus with numerical input values: In these menus, move through the digits to set the desired value. Press the right key to choose and blink the first digit of the variable from the left. Use the right key to move through the digits. Use the up/down keys to increase/decrease the value of the active digit. Set the desired values for variables by setting the individual digit values and press the left key to complete your action.



CAUTION!

If any change is made on settings, a registration procedure which is questioning whether or not to record the change will be active after return to "settings" menu. If the changes are saved, device restarts. See: 3.6.2 Save Procedure.

3.6.2 Save Procedure

Press the left key until you see the "SAVE" display to confirm or discard the changes you made.

To confirm the changes:

Press the right key to blink the "NO" sign. Use the up/down keys to change the "NO" to "YES". Then, press the left key to store the changes.

YES
SAVE

To discard the changes:

Press the right key to blink the "NO" sign. Then exit the menu using the left key without saving your changes.

NO
SAVE

3.6.3 Approval Procedure

Following query screen comes up to confirm the action or to reject. To confirm the changes:



To discard the changes:

Press the right key to blink the "NO" sign. Then exit the menu using the left key without saving your changes.

**CAUTION!**

In the Delete Menu SETTINGS ALL or ALARMS option shuts down the device after the approval of the selected transactions will be reopened. Other options for the restart process is not performed. The device returns to the CLEAR menu and perform the deletion.

4 RS485 COMMUNICATION

4.1 READABLE AND WRITABLE DATA

The following functions are supported:

- Function 03H: This function reads the readable addresses in the modbus table.
- Function 10H: This function writes to the writable addresses in the modbus table.

Specifications:

- R / W : Can read and write the value in this address.
- RO : Can only read the value in this address.
- WO : Can only write to this address.
- float : 32 bit floating number.

Related modbus table is given below:

Adress	Parametre	Type	Read / Write	Write Condition
Faz 1 Basic Measurements				
0	Phase 1 Voltage (L-N)	float	RO	
2	Phase 1-2 Voltage (L-L)	float	RO	
4	Phase 1 Current	float	RO	
6	Phase 1 Cos ϕ	float	RO	
8	Phase 1 Power Factor	float	RO	
10	Phase 1 Active Power	float	RO	
12	Phase 1 Reactive Power	float	RO	
14	Phase 1 Apparent Power	float	RO	
16	Phase 1 THDV	float	RO	
18	Phase 1 THDI	float	RO	
Phase -2 Basic Measurements				
20	Phase 2 Voltage (L-N)	float	RO	
22	Phase 2-3 Voltage (L-L)	float	RO	
24	Phase 2 Current	float	RO	
26	Phase 2 Cos ϕ	float	RO	
28	Phase 2 Power Factor	float	RO	
30	Phase 2 Active Power	float	RO	
32	Phase 2 Reactive Power	float	RO	
34	Phase 2 Apparent Power	float	RO	
36	Phase 2 THDV	float	RO	
38	Phase 2 THDI	float	RO	
Phase -3 Basic Measurements				
40	Phase 3 Voltage (L-N)	float	RO	
42	Phase 3-1 Voltage (L-L)	float	RO	
44	Phase 3 Current	float	RO	
46	Phase 3 Cos ϕ	float	RO	
48	Phase 3 Power Factor	float	RO	
50	Phase 3 Active Power	float	RO	
52	Phase 3 Reactive Power	float	RO	
54	Phase 3 Apparent Power	float	RO	
56	Phase 3 THDV	float	RO	
58	Phase 3 THDI	float	RO	
Common Measurements (Phase-1, Phase-2, Phase-3)				
60	Average Voltage (L-N)	float	RO	
62	Average Voltage (L-L)	float	RO	
64	Total Current	float	RO	
66	System Power Factor	float	RO	
68	Total Active Power	float	RO	
70	Total Reactive Power	float	RO	
72	Total Apparent Power	float	RO	
74	System Frequency	float	RO	
76	Neutral Current	float	RO	

Address	Parametre	Type	Read / Write	Write Condition
Phase-1 Voltage Harmonic Measurements (MMW03-M22CH)				
78	Phase 1 Voltage Harmonics 1	float	RO	
80	Phase 1 Voltage Harmonics 3	float	RO	
82	Phase 1 Voltage Harmonics 5	float	RO	
84	Phase 1 Voltage Harmonics 7	float	RO	
86	Phase 1 Voltage Harmonics 9	float	RO	
88	Phase 1 Voltage Harmonics 11	float	RO	
90	Phase 1 Voltage Harmonics 13	float	RO	
92	Phase 1 Voltage Harmonics 15	float	RO	
94	Phase 1 Voltage Harmonics 17	float	RO	
96	Phase 1 Voltage Harmonics 19	float	RO	
98	Phase 1 Voltage Harmonics 21	float	RO	
100	Phase 1 Voltage Harmonics 23	float	RO	
102	Phase 1 Voltage Harmonics 25	float	RO	
104	Phase 1 Voltage Harmonics 27	float	RO	
106	Phase 1 Voltage Harmonics 29	float	RO	
108	Phase 1 Voltage Harmonics 31	float	RO	
Phase-1 Current Harmonic Measurements (MMW03-M22CH)				
110	Phase 1 Current Harmonics 1	float	RO	
112	Phase 1 Current Harmonics 3	float	RO	
114	Phase 1 Current Harmonics 5	float	RO	
116	Phase 1 Current Harmonics 7	float	RO	
118	Phase 1 Current Harmonics 9	float	RO	
120	Phase 1 Current Harmonics 11	float	RO	
122	Phase 1 Current Harmonics 13	float	RO	
124	Phase 1 Current Harmonics 15	float	RO	
126	Phase 1 Current Harmonics 17	float	RO	
128	Phase 1 Current Harmonics 19	float	RO	
130	Phase 1 Current Harmonics 21	float	RO	
132	Phase 1 Current Harmonics 23	float	RO	
134	Phase 1 Current Harmonics 25	float	RO	
136	Phase 1 Current Harmonics 27	float	RO	
138	Phase 1 Current Harmonics 29	float	RO	
140	Phase 1 Current Harmonics 31	float	RO	
Phase-2 Voltage Harmonic Measurements (MMW03-M22CH)				
142	Phase 2 Voltage Harmonics 1	float	RO	
144	Phase 2 Voltage Harmonics 3	float	RO	
146	Phase 2 Voltage Harmonics 5	float	RO	
148	Phase 2 Voltage Harmonics 7	float	RO	
150	Phase 2 Voltage Harmonics 9	float	RO	
152	Phase 2 Voltage Harmonics 11	float	RO	
154	Phase 2 Voltage Harmonics 13	float	RO	
156	Phase 2 Voltage Harmonics 15	float	RO	
158	Phase 2 Voltage Harmonics 17	float	RO	
160	Phase 2 Voltage Harmonics 19	float	RO	
162	Phase 2 Voltage Harmonics 21	float	RO	
164	Phase 2 Voltage Harmonics 23	float	RO	
166	Phase 2 Voltage Harmonics 25	float	RO	
168	Phase 2 Voltage Harmonics 27	float	RO	
170	Phase 2 Voltage Harmonics 29	float	RO	
172	Phase 2 Voltage Harmonics 31	float	RO	
Phase-2 Current Harmonic Measurements (MMW03-M22CH)				
174	Phase 2 Current Harmonics 1	float	RO	
176	Phase 2 Current Harmonics 3	float	RO	
178	Phase 2 Current Harmonics 5	float	RO	
180	Phase 2 Current Harmonics 7	float	RO	
182	Phase 2 Current Harmonics 9	float	RO	
184	Phase 2 Current Harmonics 11	float	RO	
186	Phase 2 Current Harmonics 13	float	RO	
188	Phase 2 Current Harmonics 15	float	RO	
190	Phase 2 Current Harmonics 17	float	RO	
192	Phase 2 Current Harmonics 19	float	RO	

Adress	Parametre	Type	Read / Write	Write Condition
194	Phase 2 Current Harmonics 21	float	RO	
196	Phase 2 Current Harmonics 23	float	RO	
198	Phase 2 Current Harmonics 25	float	RO	
200	Phase 2 Current Harmonics 27	float	RO	
202	Phase 2 Current Harmonics 29	float	RO	
204	Phase 2 Current Harmonics 31	float	RO	
Phase-3 Voltage Harmonic Measurements (MMW03-M22CH)				
206	Phase 3 Voltage Harmonics 1	float	RO	
208	Phase 3 Voltage Harmonics 3	float	RO	
210	Phase 3 Voltage Harmonics 5	float	RO	
212	Phase 3 Voltage Harmonics 7	float	RO	
214	Phase 3 Voltage Harmonics 9	float	RO	
216	Phase 3 Voltage Harmonics 11	float	RO	
218	Phase 3 Voltage Harmonics 13	float	RO	
220	Phase 3 Voltage Harmonics 15	float	RO	
222	Phase 3 Voltage Harmonics 17	float	RO	
224	Phase 3 Voltage Harmonics 19	float	RO	
226	Phase 3 Voltage Harmonics 21	float	RO	
228	Phase 3 Voltage Harmonics 23	float	RO	
230	Phase 3 Voltage Harmonics 25	float	RO	
232	Phase 3 Voltage Harmonics 27	float	RO	
234	Phase 3 Voltage Harmonics 29	float	RO	
236	Phase 3 Voltage Harmonics 31	float	RO	
Phase-2 Current Harmonic Measurements (MMW03-M22CH)				
238	Phase 3 Current Harmonics 1	float	RO	
240	Phase 3 Current Harmonics 3	float	RO	
242	Phase 3 Current Harmonics 5	float	RO	
244	Phase 3 Current Harmonics 7	float	RO	
246	Phase 3 Current Harmonics 9	float	RO	
248	Phase 3 Current Harmonics 11	float	RO	
250	Phase 3 Current Harmonics 13	float	RO	
252	Phase 3 Current Harmonics 15	float	RO	
254	Phase 3 Current Harmonics 17	float	RO	
256	Phase 3 Current Harmonics 19	float	RO	
258	Phase 3 Current Harmonics 21	float	RO	
260	Phase 3 Current Harmonics 23	float	RO	
262	Phase 3 Current Harmonics 25	float	RO	
264	Phase 3 Current Harmonics 27	float	RO	
266	Phase 3 Current Harmonics 29	float	RO	
268	Phase 3 Current Harmonics 31	float	RO	
Phase-1 Maximum Measurements				
270	Phase 1 Max. Voltage (L-N)	float	RO	
272	Phase 1-2 Max. Voltage (L-L)	float	RO	
274	Phase 1 Max. Current	float	RO	
276	Phase 1 Max. Cos ϕ	float	RO	
278	Phase 1 Max. Power Factor	float	RO	
280	Phase 1 Max. Active Power	float	RO	
282	Phase 1 Max. Reactive Power	float	RO	
284	Phase 1 Max. Apparent Power	float	RO	
286	Phase 1 Max. THDV	float	RO	
288	Phase 1 Max. THDI	float	RO	
Phase-2 Maximum Measurements				
290	Phase 2 Max. Voltage (L-N)	float	RO	
292	Phase 2-3 Max. Voltage (L-L)	float	RO	
294	Phase 2 Max. Current	float	RO	
296	Phase 2 Max. Cos ϕ	float	RO	
298	Phase 2 Max. Power Factor	float	RO	
300	Phase 2 Max. Active Power	float	RO	
302	Phase 2 Max. Reactive Power	float	RO	
304	Phase 2 Max. Apparent Power	float	RO	
306	Phase 2 Max. THDV	float	RO	
308	Phase 2 Max. THDI	float	RO	

Address	Parameter	Type	Read / Write	Write Condition
Phase-3 Maximum Measurements				
310	Phase 3 Max. Voltage (L-N)	float	RO	
312	Phase 3-1 Max. Voltage (L-L)	float	RO	
314	Phase 3 Max. Current	float	RO	
316	Phase 3 Max. Cosφ	float	RO	
318	Phase 3 Max. Power Factor	float	RO	
320	Phase 3 Max. Active Power	float	RO	
322	Phase 3 Max. Reactive Power	float	RO	
324	Phase 3 Max. Apparent Power	float	RO	
326	Phase 3 Max. THDV	float	RO	
328	Phase 3 Max. THDI	float	RO	
Maximum Common Measurements (Phase-1, Phase-2, Phase-3)				
330	Max. Average Voltage (L-N)	float	RO	
332	Max. Average Voltage (L-L)	float	RO	
334	Max. Total Current	float	RO	
336	Max. System Power Factor	float	RO	
338	Max. Total Active Power	float	RO	
340	Max. Total Reactive Power	float	RO	
342	Max. Total Apparent Power	float	RO	
344	Max. System Frequency	float	RO	
346	Max. Neutral Current	float	RO	
Phase-1 Maximum Measurements				
348	Phase 1 Min. Voltage (L-N)	float	RO	
350	Phase 1-2 Min. Voltage (L-L)	float	RO	
352	Phase 1 Min. Current	float	RO	
354	Phase 1 Min. Cosφ	float	RO	
356	Phase 1 Min. Power Factor	float	RO	
358	Phase 1 Min. Active Power	float	RO	
360	Phase 1 Min. Reactive Power	float	RO	
362	Phase 1 Min. Apparent Power	float	RO	
364	Phase 1 Min. THDV	float	RO	
366	Phase 1 Min. THDI	float	RO	
Phase-2 Maximum Measurements				
368	Phase 2 Min. Voltage (L-N)	float	RO	
370	Phase 2-3 Min. Voltage (L-L)	float	RO	
372	Phase 2 Min. Current	float	RO	
374	Phase 2 Min. Cosφ	float	RO	
376	Phase 2 Min. Power Factor	float	RO	
378	Phase 2 Min. Active Power	float	RO	
380	Phase 2 Min. Reactive Power	float	RO	
382	Phase 2 Min. Apparent Power	float	RO	
384	Phase 2 Min. THDV	float	RO	
386	Phase 2 Min. THDI	float	RO	
Phase-3 Maximum Measurements				
388	Phase 3 Min. Voltage (L-N)	float	RO	
390	Phase 3-1 Min. Voltage (L-L)	float	RO	
392	Phase 3 Min. Current	float	RO	
394	Phase 3 Min. Cosφ	float	RO	
396	Phase 3 Min. Power Factor	float	RO	
398	Phase 3 Min. Active Power	float	RO	
400	Phase 3 Min. Reactive Power	float	RO	
402	Phase 3 Min. Apparent Power	float	RO	
404	Phase 3 Min. THDV	float	RO	
406	Phase 3 Min. THDI	float	RO	
Minimum Common Measurements (Phase-1, Phase-2, Phase-3)				
408	Min. Average Voltage (L-N)	float	RO	
410	Min. Average Voltage (L-L)	float	RO	
412	Min. Total Current	float	RO	
414	Min. System Power Factor	float	RO	
416	Min. Total Active Power	float	RO	
418	Min. Total Reactive Power	float	RO	
420	Min. Total Apparent Power	float	RO	

Adress	Parametre	Type	Read / Write	Write Condition
422	Min. System Frequency	float	RO	
424	Min. Neutral Current	float	RO	
Alarm Flags (MMW03-M22CH)				
426	Alarm Flags	32 bit integer	RO	See Table 4.2
Demand Measurements				
428	Phase 1 Current Demand	float	RO	
430	Phase 2 Current Demand	float	RO	
432	Phase 3 Current Demand	float	RO	
434	Total Current Demand	float	RO	
436	Phase 1 Active Power Demand	float	RO	
438	Phase 2 Active Power Demand	float	RO	
440	Phase 3 Active Power Demand	float	RO	
442	Total Active Power Demand	float	RO	
444	Phase 1 Reactive Power Demand	float	RO	
446	Phase 2 Reactive Power Demand	float	RO	
448	Phase 3 Reactive Power Demand	float	RO	
450	Total Reactive Power Demand	float	RO	
452	Phase 1 Apparent Power Demand	float	RO	
454	Phase 2 Apparent Power Demand	float	RO	
456	Phase 3 Apparent Power Demand	float	RO	
458	Total Apparent Power Demand	float	RO	
Digital Input				
460	Digital Input 1 Counter	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
462	Digital Input 2 Counter	32 bit integer	R / W	
464	Run Hour Counter	32 bit integer	R / W	
466	On Hour Counter	32 bit integer	RO	
468	Power Interruptions Counter	32 bit integer	RO	
Energy Meters				
Tariff 1 Total Energy Values (Phase1+Phase2+Phase3)				
470	Import Active Energy T1 (Tariff 1)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
472	Export Active Energy T1 (Tariff 1)	32 bit integer	R / W	
474	Import Reactive Energy T1 (Tariff 1)	32 bit integer	R / W	
476	Export Reactive Energy T1 (Tariff 1)	32 bit integer	R / W	
Tariff 2 Total Energy Values (Phase1+Phase2+Phase3)				
478	Import Active Energy T2 (Tariff 2)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
480	Export Active Energy T2 (Tariff 2)	32 bit integer	R / W	
482	Import Reactive Energy T2 (Tariff 2)	32 bit integer	R / W	
484	Export Reactive Energy T2 (Tariff 2)	32 bit integer	R / W	
Tariff 1 Phase1 Energy Values				
486	Import Active Energy T1-Phase1 (Tariff 1)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
488	Export Active Energy T1-Phase1 (Tariff 1)	32 bit integer	R / W	
490	Import Reactive Energy T1-Phase1 (Tariff 1)	32 bit integer	R / W	
492	Export Reactive Energy T1-Phase1 (Tariff 1)	32 bit integer	R / W	
Tariff 1 Phase 2 Energy Values				
494	Import Active Energy T1-Phase2 (Tariff 1)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
496	Export Active Energy T1-Phase2 (Tariff 1)	32 bit integer	R / W	
498	Import Reactive Energy T1-Phase2 (Tariff 1)	32 bit integer	R / W	
500	Export Reactive Energy T1-Phase2 (Tariff 1)	32 bit integer	R / W	
Tariff 1 Phase 3 Energy Values				
502	Import Active Energy T1-Phase3 (Tariff 1)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
504	Export Active Energy T1-Phase3 (Tariff 1)	32 bit integer	R / W	
506	Import Reactive Energy T1-Phase3 (Tariff 1)	32 bit integer	R / W	
508	Export Reactive Energy T1-Phase3 (Tariff 1)	32 bit integer	R / W	
Tariff 2 Phase 1 Energy Values				
510	Import Active Energy T2-Phase1 (Tariff 2)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
512	Export Active Energy T2-Phase1 (Tariff 2)	32 bit integer	R / W	
514	Import Reactive Energy T2-Phase1 (Tariff 2)	32 bit integer	R / W	
516	Export Reactive Energy T2-Phase1 (Tariff 2)	32 bit integer	R / W	

Address	Parametre	Type	Read / Write	Write Condition
Tariff 2 Phase 2 Energy Values				
518	Import Active Energy T2-Phase2 (Tariff 2)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
520	Export Active Energy T2-Phase2 (Tariff 2)	32 bit integer	R / W	
522	Import Reactive Energy T2-Phase2 (Tariff 2)	32 bit integer	R / W	
524	Export Reactive Energy T2-Phase2 (Tariff 2)	32 bit integer	R / W	
Tariff 2 Phase 3 Energy Values				
526	Import Active Energy T2-Phase3 (Tariff 2)	32 bit integer	R / W	If password protection is active, enter the password in the "Settings Protection" field and then enter "2222" in the "Enable Counter Change" field. You can then enter the value.
528	Export Active Energy T2-Phase3 (Tariff 2)	32 bit integer	R / W	
530	Import Reactive Energy T2-Phase3 (Tariff 2)	32 bit integer	R / W	
532	Export Reactive Energy T2-Phase3 (Tariff 2)	32 bit integer	R / W	
Device Settings				
534	Current Transfer Rate (CTR)	32 bit integer	R / W	Enter the password in the "Settings Protection" field if password protection is enabled.
536	Voltage Transfer Rate (VTR)	float	R / W	
538	Connection Type	32 bit integer	R / W	
540	Relay 1 Function (MMW03-M22CH)	32 bit integer	R / W	
542	Relay 2 Function (MMW03-M22CH)	32 bit integer	R / W	
544	Demand Time	32 bit integer	R / W	
546	Password Enable	32 bit integer	R / W	
548	Password Activation Time	32 bit integer	R / W	
550	Password Value	32 bit integer	R / W	
552	Baud Rate	32 bit integer	R / W	
554	Slave ID	32 bit integer	R / W	
556	Parity Control	32 bit integer	R / W	
558	Digital Input 1 Type	32 bit integer	R / W	
560	Digital Input 1 Delay Time	32 bit integer	R / W	
562	Digital Input 1 Edge	32 bit integer	R / W	
564	Digital Input 2 Type	32 bit integer	R / W	
566	Digital Input 2 Delay Time	32 bit integer	R / W	
568	Digital Input 2 Edge	32 bit integer	R / W	
570	Pulse Output 1 Parameter	32 bit integer	R / W	
572	Pulse Output 1 Duration	32 bit integer	R / W	
574	Pulse Output 1 Rate	32 bit integer	R / W	
576	Pulse Output 2 Parameter	32 bit integer	R / W	
578	Pulse Output 2 Duration	32 bit integer	R / W	
580	Pulse Output 2 Rate	32 bit integer	R / W	
582	Menu Scroll On/Off	32 bit integer	R / W	
584	Menu Display Period	32 bit integer	R / W	
586	Home page Setup	32 bit integer	R / W	
588	Display backlight options	32 bit integer	R / W	
590	Display backlight on time	32 bit integer	R / W	
Alarm Settings				
592	Voltage (L-N) Alarm High Limit	float	R / W	Enter the password in the "Settings Protection" field if password protection is enabled.
594	Voltage (L-N) Alarm Low Limit	float	R / W	
596	Voltage (L-N) Alarm Hysteresis	float	R / W	
598	Voltage (L-N) Alarm Delay Time	32 bit integer	R / W	
600	Voltage (L-L) Alarm High Limit	float	R / W	
602	Voltage (L-L) Alarm Low Limit	float	R / W	
604	Voltage (L-L) Alarm Hysteresis	float	R / W	
606	Voltage (L-L) Alarm Delay Time	32 bit integer	R / W	
608	Current Alarm High Limit	float	R / W	
610	Current Alarm Low Limit	float	R / W	
612	Current Alarm Hysteresis	float	R / W	
614	Current Alarm Delay Time	32 bit integer	R / W	
616	Neutral Current Alarm High Limit	float	R / W	
618	Neutral Current Alarm Low Limit	float	R / W	
620	Neutral Current Alarm Hysteresis	float	R / W	

Adress	Parametre	Type	Read / Write	Write Condition
622	Neutral Current Alarm Delay Time	32 bit integer	R / W	Enter the password in the "Settings Protection" field if password protection is enabled.
624	Cosφ Alarm High Limit	float	R / W	
626	Cosφ Alarm Low Limit	float	R / W	
628	Cosφ Alarm Hysteresis	float	R / W	
630	Cosφ Alarm Delay Time	32 bit integer	R / W	
632	Power Factor Alarm High Limit	float	R / W	
634	Power Factor Alarm Low Limit	float	R / W	
636	Power Factor Alarm Hysteresis	float	R / W	
638	Power Factor Alarm Delay Time	32 bit integer	R / W	
640	Frequency Alarm High Limit	float	R / W	
642	Frequency Alarm Low Limit	float	R / W	
644	Frequency Alarm Hysteresis	float	R / W	
646	Frequency Alarm Delay Time	32 bit integer	R / W	
Device Model				
648	Device Firmware Version	float	RO	
650	Device Model	32 bit integer	RO	
Password/Pin activation				
652	Setting protection	32 bit integer	R / W	Address for the device password. It displays the enabled/disabled condition of the password protection when reading using.
Reset Commands				
1000	Reset Energy Values	32 bit integer	WO	Enter the password in the "Settings Protection" field if password protection is enabled. Enter "1" into the respective address to reset the values. Enter "0" before saving to restore the values.
1002	Reset Counter Values	32 bit integer	WO	
1004	Reset Max. Values	32 bit integer	WO	
1006	Reset Min. Values	32 bit integer	WO	
1008	Reset Demand Values	32 bit integer	WO	
1010	Reset Settings	32 bit integer	WO	
1012	Reset Alarm Limits(MMW03-M22CH)	32 bit integer	WO	
1014	Reset the Device to Factory Settings	32 bit integer	WO	
Save The Changes				
2000	Save Changes	32 bit integer	WO	Enter the password in the "Settings Protection" field if password protection is enabled. Enter "1" to save the changes and restart.
Manual Output Relay Control				
4000	Enable Relay Control	32 bit integer	WO	Enter the password in the "Settings Protection" field if password protection is enabled. Enter "1111" here to enable the relay control. Enter "0" here to disable the relay control.
4002	Relay 1 Control	32 bit integer	WO	Enter the password in the "Settings Protection" field if password protection is enabled. Then, enter "1111" for the "Enable Relay Control" address. Enter "1" to activate, "0" to de-activate the relay.
4004	Relay 1 Control	32 bit integer	WO	Enter the password in the "Settings Protection" field if password protection is enabled. Then, enter "1111" for the "Enable Relay Control" address. Enter "1" to activate, "0" to de-activate the relay.
Enable/Disable to Assigning Predefined Value for Energy Meters				
5000	Enable Counter Change	32 bit integer	WO	Enter the password in the "Settings Protection" field if password protection is enabled. Enter "2222" here to enable assigning the relay control. Enter "0" here to disable the meter assignment.

Tabela 4.1: Readable and Writable Data

4.1.1 Status/Alarm Flags

“Alarm Flags” modbus address showing the alarm conditions and alarm conditions represented with bits are given below.

458 Alarm Flags															
31	30	29	28	27	26	25	24	23	22	21	20	19	18	17	16
D2 Status	D1 Status	Relay2 Status	Relay2 Status	DO2 Status	DO1 Status	Reserve/OFF					SEQ	I3 OFF	I2 OFF	I1 OFF	V3 OFF
15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
V2 OFF	V1 OFF	Freq Low	Freq High	PF Low	PF High	Cosφ Low	Cosφ High	I(Nötr) Low	I(Nötr) High	I Low	I High	V(L-L) Low	V(L-L) High	V(L-N) Low	V(L-N) High

Tabela 4.2: Alarm Flags

bit Description

- 31 : DI2 Status: Digital input 2 signal condition (active or passive).
- 30 : DI1 Status: Digital input 1 signal condition (active or passive).
- 29 : DI1 Status: Digital input 1 signal condition (active or passive).
- 28 : Relay 1 Status: Relay 1 active/pasive status.
- 27 : DO2 Status: Digital Output 2 active/pasive status.
- 26 : DO1 Status: Digital Output 1 active/pasive status.
- 25-21 : Reserve.
- 20 : SEQ - Phase Order Alarm.
- 19 : I3 OFF - 3. No current in Line-3.
- 18 : I2 OFF - 2. No current in Line-2.
- 17 : I1 OFF - 1. No current in Line-1.
- 16 : V3 OFF - 3. No voltage in Line-3.
- 15 : V2 OFF - 2. No voltage Line-2.
- 14 : V1 OFF - 1. No voltage in Line-1.
- 13 : Freq Low - Low frequency alarm.
- 12 : Freq High - High frequency alarm.
- 11 : PF Low - Low power factor alarm.
- 10 : PF High - High power factor alarm.
- 9 : Cos φ Low - Low Cos φ alarm.
- 8 : Cos φ High - High Cos φ alarm.
- 7 : I(N) Low - Low neutral current alarm.
- 6 : I(N) High - High neutral current alarm.
- 5 : I Low - Low current alarm.
- 4 : I High - High current alarm.
- 3 : V(L-L) Low - Low phase-phase voltage alarm.
- 2 : V(L-L) High - High phase-phase voltage alarm.
- 1 : V(L-N) Low - Low phase-neutral voltage alarm.
- 0 : V(L-N) High - High phase-neutral voltage alarm.



CAUTION!

If the device was not restarted after entering the password or the “password activation time” has not elapsed, this will read “0” to indicate that password protection is disabled in the “Settings protection” address (modbus adr: 604). In this case, you don't need to re-enter the password.

Password activation time resets and restarts each time a modbus write action is performed or a key is pressed.

4.2 MULTIPLE CHOICE SETTINGS VIA MODBUS

Modbus addresses for the multiple choice settings, input values and their descriptions are given below.

Adress	Register name	Write value	Description name
538	Connection Type	0	3P4W
		1	3P3W
540	Relay 1 Function	0	OFF
		1	LOW
		2	HIGH
542	Relay 2 Function	0	OFF
		1	LOW
		2	HIGH
546	Password Enable	0	OFF
		1	ON
552	Baud Rate	0	1200 baud
		1	2400 baud
		2	4800 baud
		3	9600 baud
		4	19200 baud
		5	38400 baud
		6	57600 baud
556	Party Control	0	NONE
		1	EVEN
		2	ODD
558	Digital Input 1 Type	0	OFF
		1	TARIFF 2
		2	COUNTER
		3	RUN HOUR
562	Sayısal Giriş 1 Edge	0	RISING
		1	FALLING
		2	BOTH EDG
564	Sayısal Giriş 1 Edge	0	OFF
		1	TARIFF 2
		2	COUNTER
		3	RUN HOUR
568	Digital Input 2 Edge	0	RISING
		1	FALLING
		2	BOTH EDG

Adress	Register name	Write value	Description name
570	Pulse Output 1 Parameter	0	OFF
		1	IMP ACT1
		2	EXP ACT1
		3	IMP REA1
		4	EXP REA1
		5	IMP ACT2
		6	EXP ACT2
		7	IMP REA2
		8	EXP REA2
		9	DIN1
		10	DIN2
576	Pulse Output 2 Parameter	0	OFF
		1	IMP ACT1
		2	EXP ACT1
		3	IMP REA1
		4	EXP REA1
		5	IMP ACT2
		6	EXP ACT2
		7	IMP REA2
		8	EXP REA2
		9	DIN1
		10	DIN2
582	Menu Scroll On/Of	0	OFF
		1	ON
586	Home Page Settings	0	VOLTAGE (L-N)
		1	VOLTAGE (L-L)
		2	CURRENT
		3	I NEUTR
		4	COSQ
		5	PF
		6	POWER P
		7	POWER Q
		8	POWER S
		9	P-Q-S
		10	FREQ
		11	THD V
		12	THD I
588	Display Backlights Options	0	TIME DEP
		1	CONT ON
		2	CONT OFF

Tabela 4.3: Description List

5 FACTORY DEFAULT SETTINGS

Menu	Sub Menu 1	Sub Menu 2	Description	Default Value	Unit	Setting Range
BASIC	Ctr		Current transformer ratio	1	-	0.00 - 1.00
	Utr		Voltage transformer ratio	1.0	-	0.00 - 1.00
	Conn		Connection type options	3P4W	-	0.00 - 1.00
ALARMS	VLN ALM	HI	Voltage (phase-neutral) alarm high limit	0.0	V	0 - 60
		LO	Voltage (phase-neutral) alarm low limit	0.0	V	45.0 - 65.0
		hYSt	Voltage (phase-neutral) alarm hysteresis value	5.0	V	45.0 - 65.0
		dLY.t	Voltage (phase-neutral) alarm delay time	5	sn	0.0 - 20.0
	VLL ALM	HI	Voltage (phase-phase) alarm high limit	0.0	V	0 - 60
		LO	Voltage (phase-phase) alarm high low limit	0.0	V	OFF/LOW/HIGH
		hYSt	Voltage (phase-phase) alarm hysteresis value	5.0	V	OFF/LOW/HIGH
		dLY.t	Voltage (phase-phase) alarm delay time	5	sn	1 - 60
	I ALM	HI	Current alarm high limit	0.0	A	1200/2400/4800/9600/19200/38
		LO	Current alarm low limit	0.0	A	400/57600
		hYSt	Current alarm hysteresis value	0.1	A	1 - 247
		dLY.t	Current alarm delay value	5	sn	NONE/EVEN/ODD
	IN ALM	HI	Neutral current alarm high limit	0.0	A	OFF/TARIFF 2/COUNTER/RUN HOUR
		LO	Neutral current alarm low limit	0.0	A	10 - 2000
		hYSt	Neutral current hysteresis value	0.1	A	RISING/FALLING/BOTH EDG
		dLY.t	Neutral current alarm delay value	5	sn	OFF/TARIFF 2/COUNTER/RUN HOUR
COSQ ALM	HI	cos alarm high limit	0.00	-	10 - 2000	
	LO	cos alarm low limit	0.00	-	RISING/FALLING/BOTH EDG	
	hYSt	cos alarm hysteresis value	0.01	-	0.00 - 1.00	
	dLY.t	cos alarm delay time	5	sn	0 - 60	
ALARMS	PF ALM	HI	Power factor alarm high limit	0.00	-	0.00 - 1.00
		LO	Power factor alarm low limit	0.00	-	0.00 - 1.00
		hYSt	Power factor alarm hysteresis value	0.01	-	0.00 - 1.00
		dLY.t	Power factor alarm delay time	5	sn	0 - 60
	FREQ ALM	HI	Frequency alarm high limit	50.0	Hz	45.0 - 65.0
		LO	Frequency alarm low limit	50.0	Hz	45.0 - 65.0
		hYSt	Frequency alarm hysteresis value	2.0	Hz	0.0 - 20.0
dLY.t	Frequency alarm delay time	5	sn	0 - 60		
RELAYS	rLY1		Relay 1 setup	OFF	-	OFF/LOW/HIGH
	rLY2		Relay 2 setup	OFF	-	OFF/LOW/HIGH
DEMAND	dEd.s		Demand time setup	15	dk	1 - 60
RS485	bAud		Baud rate options	38400	Baud	1200/2400/4800/9600/19200/38 400/57600
	Id		Slave ID setup	1	-	1 - 247
	PrtY		Parity check setup	NONE	-	NONE/EVEN/ODD
DI INPUT	INPUT1	tYPE	Digital input 1 options	OFF	-	OFF/TARIFF 2/COUNTER/RUN HOUR
		dLY	Digital input 1 detection delay time	10	msn	10 - 2000
		EdgE	Digital input 1 detection edge	RISING	-	RISING/FALLING/BOTH EDG
	INPUT2	tYPE	Digital input 2 options	OFF	-	OFF/TARIFF 2/COUNTER/RUN HOUR
		dLY	Digital input 2 detection delay time	10	msn	10 - 2000
			Digital input 2 detection edge	RISING	-	RISING/FALLING/BOTH EDG

Menu	Sub Menu 1	Sub Menu 2	Description	Default Value	Unit	Setting Range
PULSE	OUT1	OUT	Pulse output 1 parameter setup	OFF	-	OFF / IMP ACT1 / EXP ACT1 / IMP REA1 / EXP REA1 / IMP ACT2 / EXP ACT2 / IMP REA2 / EXP REA2 / DIN1 / DIN2
		durA	Pulse duration of the pulse output 1	50	msn	50 - 2500
		rAt	Step range for pulse output 1	1	kWh/ kVArh Qty	1 - 99 999 999
	OUT2	OUT	Pulse output 2 parameter setup	OFF	-	OFF / IMP ACT1 / EXP ACT1 / IMP REA1 / EXP REA1 / IMP ACT2 / EXP ACT2 / IMP REA2 / EXP REA2 / DIN1 / DIN2
		durA	Pulse duration of the pulse output 2	50	msn	50 - 2500
			Step range for pulse output 2	1	kWh/ kVArh Qty	1 - 99 999 999
SIFRE	Act		Enable/disable password protection	NO	-	NO/YES
	Pin.t		Timeout for password protection	10	dk	1 - 60
	Pin		Change password	1	-	1 - 9999
DISPLAY	MENU	ScrL	Menu scroll on/off	OFF	-	OFF/ON
		Scr.P	Menu display time	3	sn	1 - 60
		Strt	Home page setup	VOLTAGE LN	-	VOLTAGELN / VOLTAGELL / CURRENT / I NEUTR / COSQ / PF / POWER P / POWER Q / POWER S / Σ P-Q-S / FREQ / THD V / THD I
	BACKLGHT	oPt	Display backlight options	TIME DEP	-	TIME DEP/CONT ON/CONT OFF
		durA	Display backlight on time	600	sn	10 - 600
CLEAR	CLr		Clear menu	OFF	-	OFF / ALL / ENERGY / COUNTERS / MAX VALS / MIN VALS / DEMANDS / SETTINGS / ALARMS

6 TECHNICAL SPECIFICATIONS

Supply		
Voltage	85..300 V AC/DC	
Frequency	45..65Hz	
Power Consumption	< 4.5VA & <2W	
Measurement Inputs		
Voltage	5..300V AC (L - N)	
	10..500V AC (L - L)	
Current	10mA .. 6A AC	
Frequency	45..65Hz	
Network Connection Type	3 phase 4 wire, 3 phase 3 wire	
Digital Input		
Input Type	Dry Contact	
Isolation	5000V RMS	
Digital Output		
Output Type	Transistor	
Switching Voltage	5..30V DC	
Switching Current	50mA	
Isolation	5000V RMS	
Relay Output (MMW03-M22CH)		
	AC	DC
Maximum Switching Voltage	250V	30V
Maximum Switching Current	10A	5A
Maximum Switching Power	1250VA	150W
General		
Operating Temperature	-20°C..+70°C	
Storage Temperature	-30°C..+80°C	
Protection Class	IP40	
Relative Humidity	% 95 non-condensing	

Measurement Accuracy				
Symbol	Measurement Type	Class According to IEC 61557-12	Measurement Range	Other Standards
P	Total Active Power	0,5	10% $I_b \leq I \leq I_{max}$ 0,5 Ind to 0,8 Cap	-
Q _V	Total Reactive Power	1	5 % $I_b \leq I \leq I_{max}$ 0,25 Ind to 0,25 Cap	-
tS _A	Total Apparent Power	0,5	10% $I_b \leq I \leq I_{max}$ 0,5 Ind to 0,8 Cap	-
E _A	Total Active Energy	0,5	0 - 99999999 kWh 0-99 999 99.9 kWh (POWYS 3122)	IEC 62053-22 Class 0.5S
E _V	Total Reactive Energy	2	0 - 99999999 kVarh 0-99 999 99.9 kVarh (POWYS 3122)	IEC 62053-23 Class 2
f	Frequency	0,1	45 – 65 Hz	-
I	Phase Current	0,5	20 % $I_b \leq I \leq I_{max}$	-
I _{Nc}	Neutral Current (Measured)	0,5	20 % $I_b \leq I \leq I_{max}$	-
U	Voltage	0,2	$U_{min} \leq U \leq U_{max}$	-
PF _A	Power Factor	0,5	0,5 Ind to 0,8 Cap	-
THDV	Total Harmonic Distortion Voltage	1	0 % to 20 %	-
THDI	Total Harmonic Distortion Current	1	0 % to 100 %	-



WEG Group - Automation Business Unit
Jaraguá do Sul - SC - Brazil
Phone: +55 47 3276 4000
automacao@weg.net
www.weg.net

Cod: 14903957 | Rev: 00 | Data (m/a): 04/2019
Subject to change without prior notice. The information contained herein is the reference value.