




- 1) TURN OFF AND LOCK OUT ALL POWER SUPPLYING THIS EQUIPMENT BEFORE WORKING ON OR INSIDE EQUIPMENT.
- 2) REPLACE ALL DEVICES, DOORS, AND COVERS BEFORE TURNING ON POWER TO THIS EQUIPMENT.
- 3) ALWAYS VERIFY THAT NO VOLTAGE IS PRESENT BEFORE WORKING ON OR INSIDE EQUIPMENT, AND ALWAYS FOLLOW GENERALLY ACCEPTED SAFETY PROCEDURES.

FAILURE TO FOLLOW THESE INSTRUCTIONS WILL RESULT IN DEATH OR SEVERE INJURY.

BS* / BD

- Bobina de disparo por subtensão
- Bobina de disparo à distância
- Undervoltage release
- Shunt release
- Bobina de disparo por mínima tensão
- Bobina de disparo
- Unterspannungsauslöser
- Arbeitsstromauslöser

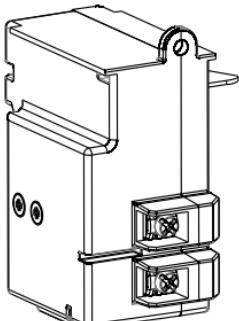

- * Impossível o rearne do disjuntor de caixa moldada se a bobina de subtensão BS não estiver energizada.
- * It is not possible to reset the molded case circuit breaker if the undervoltage release is not energized.
- * Si la bobina de mínima tensión BS no es alimentada, es imposible para cerrar el interruptor.
- * Wenn die Unterspannungsauslöser BS nicht eingespeist wird, ist es unmöglich, den Leistungsschalter zu schließen.

ATENÇÃO:

- Desconecte da rede elétrica antes de proceder qualquer trabalho neste equipamento.
- Somente profissionais qualificados podem efetuar a instalação e manutenção.
- Obedecer normas nacionais, estaduais, locais e instruções de operação.

WARNING:

- Installation and maintenance to be performed by authorized personnel only.
- User is cautioned to observe all recommendations, warnings and cautions relating to safety of personnel and equipment as well as general and local health and safety laws, codes and procedures.

ATENCIÓN:

- Desconectar de la red eléctrica antes de hacer cualquier trabajo en este equipo.
- Recomiéndase instalación por profesional calificado.
- Respetar normas nacionales y locales.
- Producto destinado a utilización en instalaciones eléctricas de baja tensión.

WANRUNG:

- Bevor irgend eine Arbeit am Gerät vorgenommen wird, muss sichergestellt sein, dass die Einheit stromlos und freigeschaltet ist.
- Sämtliche Arbeiten an der Einheit dürfen daher ausschließlich nur von Fachpersonal vorgenommen werden.
- Die jeweils geltenden nationalen, örtlichen und anlagen spezifischen Bestimmungen und Erfordernisse sind zu berücksichtigen.

